

LIVONIA PUBLIC SCHOOLS

FRANKLIN HIGH SCHOOL  
POOL FILTRATION PROJECT

LIVONIA, MICHIGAN

PROJECT NO. 2025-042.2

12/10/2025

BIDS



FRENCH

LIST OF DRAWINGS

ARCHITECTURAL

- A0.01 ARCHITECTURAL REFERENCE SHEET
- A0.02 COMPOSITE CODE PLAN

POOL

- AQ0.0 POOL REFERENCE PLAN
- AQ0.0.1 UNIT Q POOL MECHANICAL ROOM DEMOLITION PLANS
- AQ0.0.2 UNIT Q POOL MECHANICAL ROOM EXISTING CONDITIONS
- AQ0.0.3 UNIT Q POOL MECHANICAL ROOM EXISTING CONDITIONS
- AQ1.0 POOL MECHANICAL & CHEMICAL ROOM PLANS & SECTION
- AQ1.1 POOL MECHANICAL DETAILS
- AQ1.2 POOL MECHANICAL DETAILS
- AQ1.3 POOL MECHANICAL DETAILS
- AQ2.0 POOL SYSTEMS DETAILS

ELECTRICAL

- E0.00 ELECTRICAL GENERAL INFORMATION
- EPD2.00G ELECTRICAL POWER DEMOLITION TUNNEL PLAN - UNIT G
- EPD2.10G ELECTRICAL POWER DEMOLITION FIRST FLOOR PLAN - UNIT G
- EP2.00G ELECTRICAL POWER NEW WORK TUNNEL PLAN - UNIT G
- EP2.10G ELECTRICAL POWER NEW WORK FIRST FLOOR PLAN - UNIT G
- E5.00 ELECTRICAL DETAILS AND PANEL SCHEDULES

REFERENCE LOCATION MAP







- 1) Design Codes
  - a) 2021 MICHIGAN REHABILITATION CODE (EXISTING BUILDING)
  - b) 2016 SCHOOL FIRE SAFETY RULES WITH ADOPTION OF NFPA 101 LIFE SAFETY CODE 2012 EDITION
  - c) 2021 MICHIGAN PLUMBING CODE
  - d) 2021 MICHIGAN MECHANICAL CODE
  - e) 2021 MICHIGAN URBAN ENERGY CODE
  - f) 2023 MICHIGAN ELECTRICAL CODE RULES, PART 8
  - g) 2023 NATIONAL ELECTRICAL CODE (NFPA 70)
  - h) 2017 ICC A117.1 ACCESSIBLE AND USABLE BUILDINGS & FACILITIES
- 2) DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE (106.6)
  - a) A REPRESENTATIVE OF FRENCH ASSOCIATES WILL BE THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE.
- 3) EXISTING BUILDING INFORMATION
  - a) TOTAL BUILDING = 319,090 SQUARE FEET (NO CHANGE).
  - b) THE BUILDING IS PARTIALLY SPRINKLED - PERFORMING ARTS STAGE ONLY.
  - c) TYPE OF CONSTRUCTION IS IIB (II-KOM FROM SCHOOL FIRE SAFETY RULES)
  - d) USE GROUP IS OCCUPANCY E (EDUCATION)
- 4) COMPLIANCE METHOD (CHAPTER 3)
  - a) WORK AREA COMPLIES WITH THE MICHIGAN REHABILITATION CODE (301.1.2) - THE WORK SHALL COMPLY WITH THE APPLICABLE REQUIREMENTS OF CHAPTERS 5 THROUGH 11.
- 5) CLASSIFICATION OF WORK (CHAPTER 5)
  - a) AS DEFINED BY THE MICHIGAN REHABILITATION CODE, THE WORK INCLUDES LEVEL 1 ALTERATIONS AND LEVEL 2 ALTERATIONS. THE WORK AREA DOES NOT EXCEEDS 50% OF THE BUILDING AREA.
  - b) THERE IS NO CHANGE OF OCCUPANCY.
  - c) THERE IS NO ADDITION.
  - d) UNDER THE SCHOOL FIRE SAFETY RULES, THE SCOPE OF WORK IN THE LEVEL 1 ALTERATIONS IS THE REPLACEMENT OF EXISTING POOL AND RELATED ELECTRICAL SYSTEMS. AS A RESULT, THE LEVEL 1 ALTERATION AREAS DO NOT QUALIFY AS REMODELING.
- 6) CHAPTER 7 - ALTERATIONS- LEVEL 1
  - a) SECTION 702.1 - NEW FINISHES SHALL COMPLY WITH CHAPTER 8 OF THE MICHIGAN BUILDING CODE.
  - i) FROM TABLE 803.9- CORRIDORS ARE CLASS B FINISHES, ROOMS ARE CLASS C FINISHES
  - b) INTERIOR FLOOR FINISHES SHALL COMPLY WITH SECTION 804 OF MBC.

EXISTING BUILDING AREA: 319,090 SQUARE FEET

STUDENT POPULATION IS NOT CHANGING


WORK AREA COMPLIANCE METHOD: LEVEL 1 ALTERATIONS

NO CHANGE OF USE

EXISTING BUILDING IS NOT SPRINKLED (EXCEPT PERFORMING ARTS AREA).

**ALTERATION LEVEL 1 DESCRIPTION:**

- REPLACEMENT AND UPGRADING OF EXISTING POOL EQUIPMENT SYSTEMS (INCLUDING RELATED ELECTRICAL).

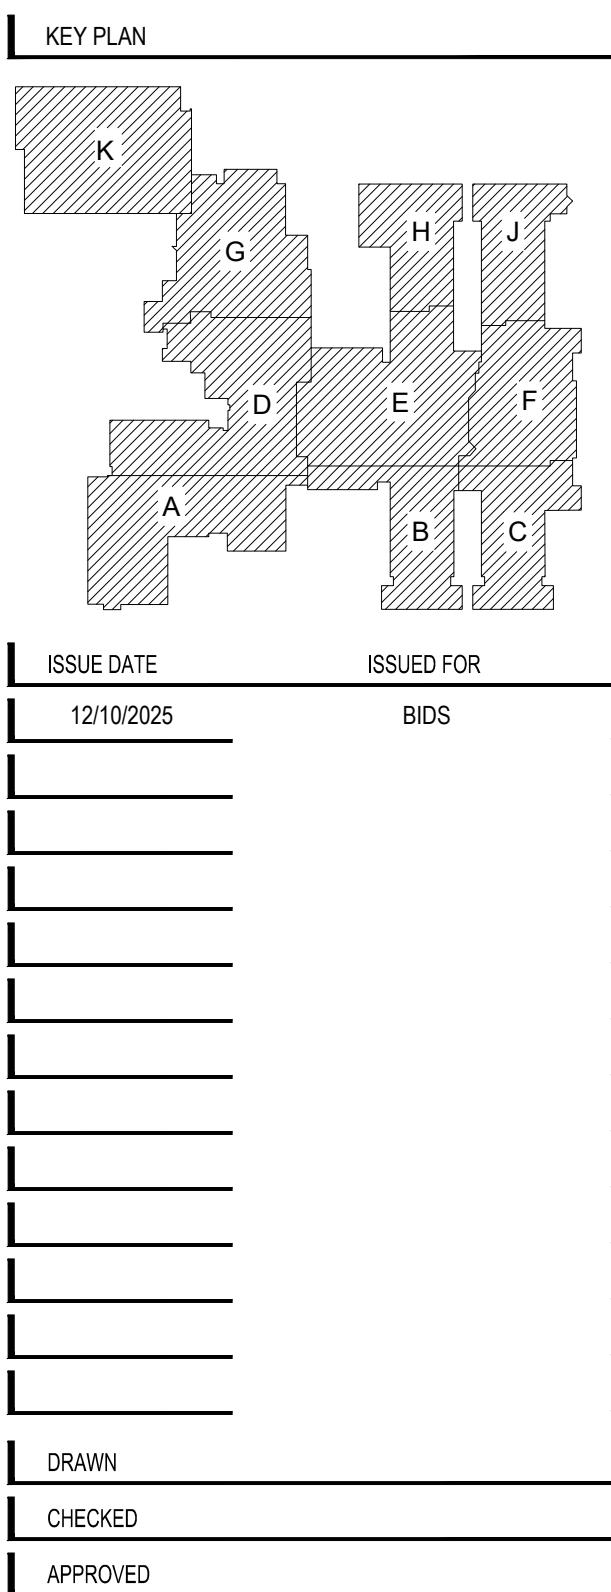

SHEET  
COMPOSITE  
CODE PLAN

SHEET NUMBER

A0.02



DESIGN DATA		
	UNITS	EXISTING POOL
LENGTH	FT.	VARIES
WIDTH	FT.	VARIES
WATER SURFACE AREA	SQ. FT.	3,847
PERIMETER	FT.	288'-0"
VOLUME	GALLONS	186,000
RECIRCULATION SYSTEM		
POOL TURNOVER RATE	HOURS	6.0
RECIRCULATION RATE	GPM	517
SURGE CAPACITY	GALLONS	EXISTING TO REMAIN
SEWER CAPACITY	GPM	REFER TO PLUMBING
BATHER LOAD	PERSONS	234

- GENERAL POOL NOTES
1.

◆ DENOTES WATER DEPTH FROM WATER LEVEL.
2.

(ALTERNATE #1) POOL FINISH TO RECEIVE ACID WASHING AND REGROUT. REFER TO SPECIFICATION 131100.
3.

ALL PROPRIETARY NAMES MENTIONED ARE TO DESIGNATE PERFORMANCE STANDARDS. EQUIVALENT PRODUCTS MUST BE SUBMITTED FOR APPROVAL.
4.

ALL POOL REINFORCING STEEL, METAL FITTINGS, EQUIPMENT WITHIN 5'-0" OF POOL EDGE, AND ANY METAL PARTS OF POOL MECHANICAL EQUIPMENT IN CONTACT WITH THE POOL RECIRCULATION SYSTEM MUST BE BONDED PER NEC 680. REFER: 1/AQ1.2

CONTRACTOR SUPPLIED POOL CHEMICALS	
DESCRIPTION	AMOUNT
CO2	FULL BULK TANK(S) : 750 LBS

DRAWING INDEX	
SHEET	DESCRIPTION
AQ0.0	POOL REFERENCE PLAN
AQ0.1	POOL MECHANICAL & CHEMICAL ROOM DEMOLITION PLANS
AQ0.2	POOL MECHANICAL ROOM EXISTING CONDITIONS
AQ0.3	POOL CHEMICAL ROOM EXISTING CONDITIONS
AQ1.0	POOL MECHANICAL & CHEMICAL ROOM PLANS & SECTION
AQ1.1	POOL MECHANICAL DETAILS
AQ1.2	POOL MECHANICAL DETAILS
AQ1.3	POOL MECHANICAL DETAILS
AQ2.0	POOL SYSTEMS SCHEMATIC

POOL ALTERNATES	
ALTERNATE #1 - ACID WASH THE INTERIOR POOL TILE AND RE-GROUT WITH MATERIAL COMPATIBLE WITH EXISTING FINISHES.	

K

G

H

J

D

E

F

A

B

C

ISSUE DATE

12/10/2025

ISSUED FOR

BIDS

DRAWN

ZRW

CHECKED

MJM

APPROVED

CPN


STATE OF MICHIGAN

CARL P. NYLANDER

ENGINEER

NO. 630108629

PROFESSIONAL SEAL

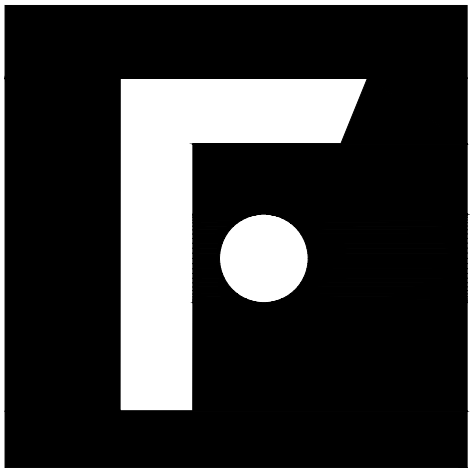

FRENCH

2851 High Meadow Circle | Suite 100  
Auburn Hills | MI 48326  
248.656.1377

PROJECT  
Livonia Public Schools  
Franklin High School  
Pool Filtration Project

Livonia,  
Michigan


SHEET  
Unit G  
POOL REFERENCE  
PLAN

PROJECT NUMBER  
2025-042.2

SHEET NUMBER  
AQ0.0



COUNSLMAN+HUNSAKER  
AQUATICS FOR LIFE  
ph: 314.894.1245 • www.chh2o.com

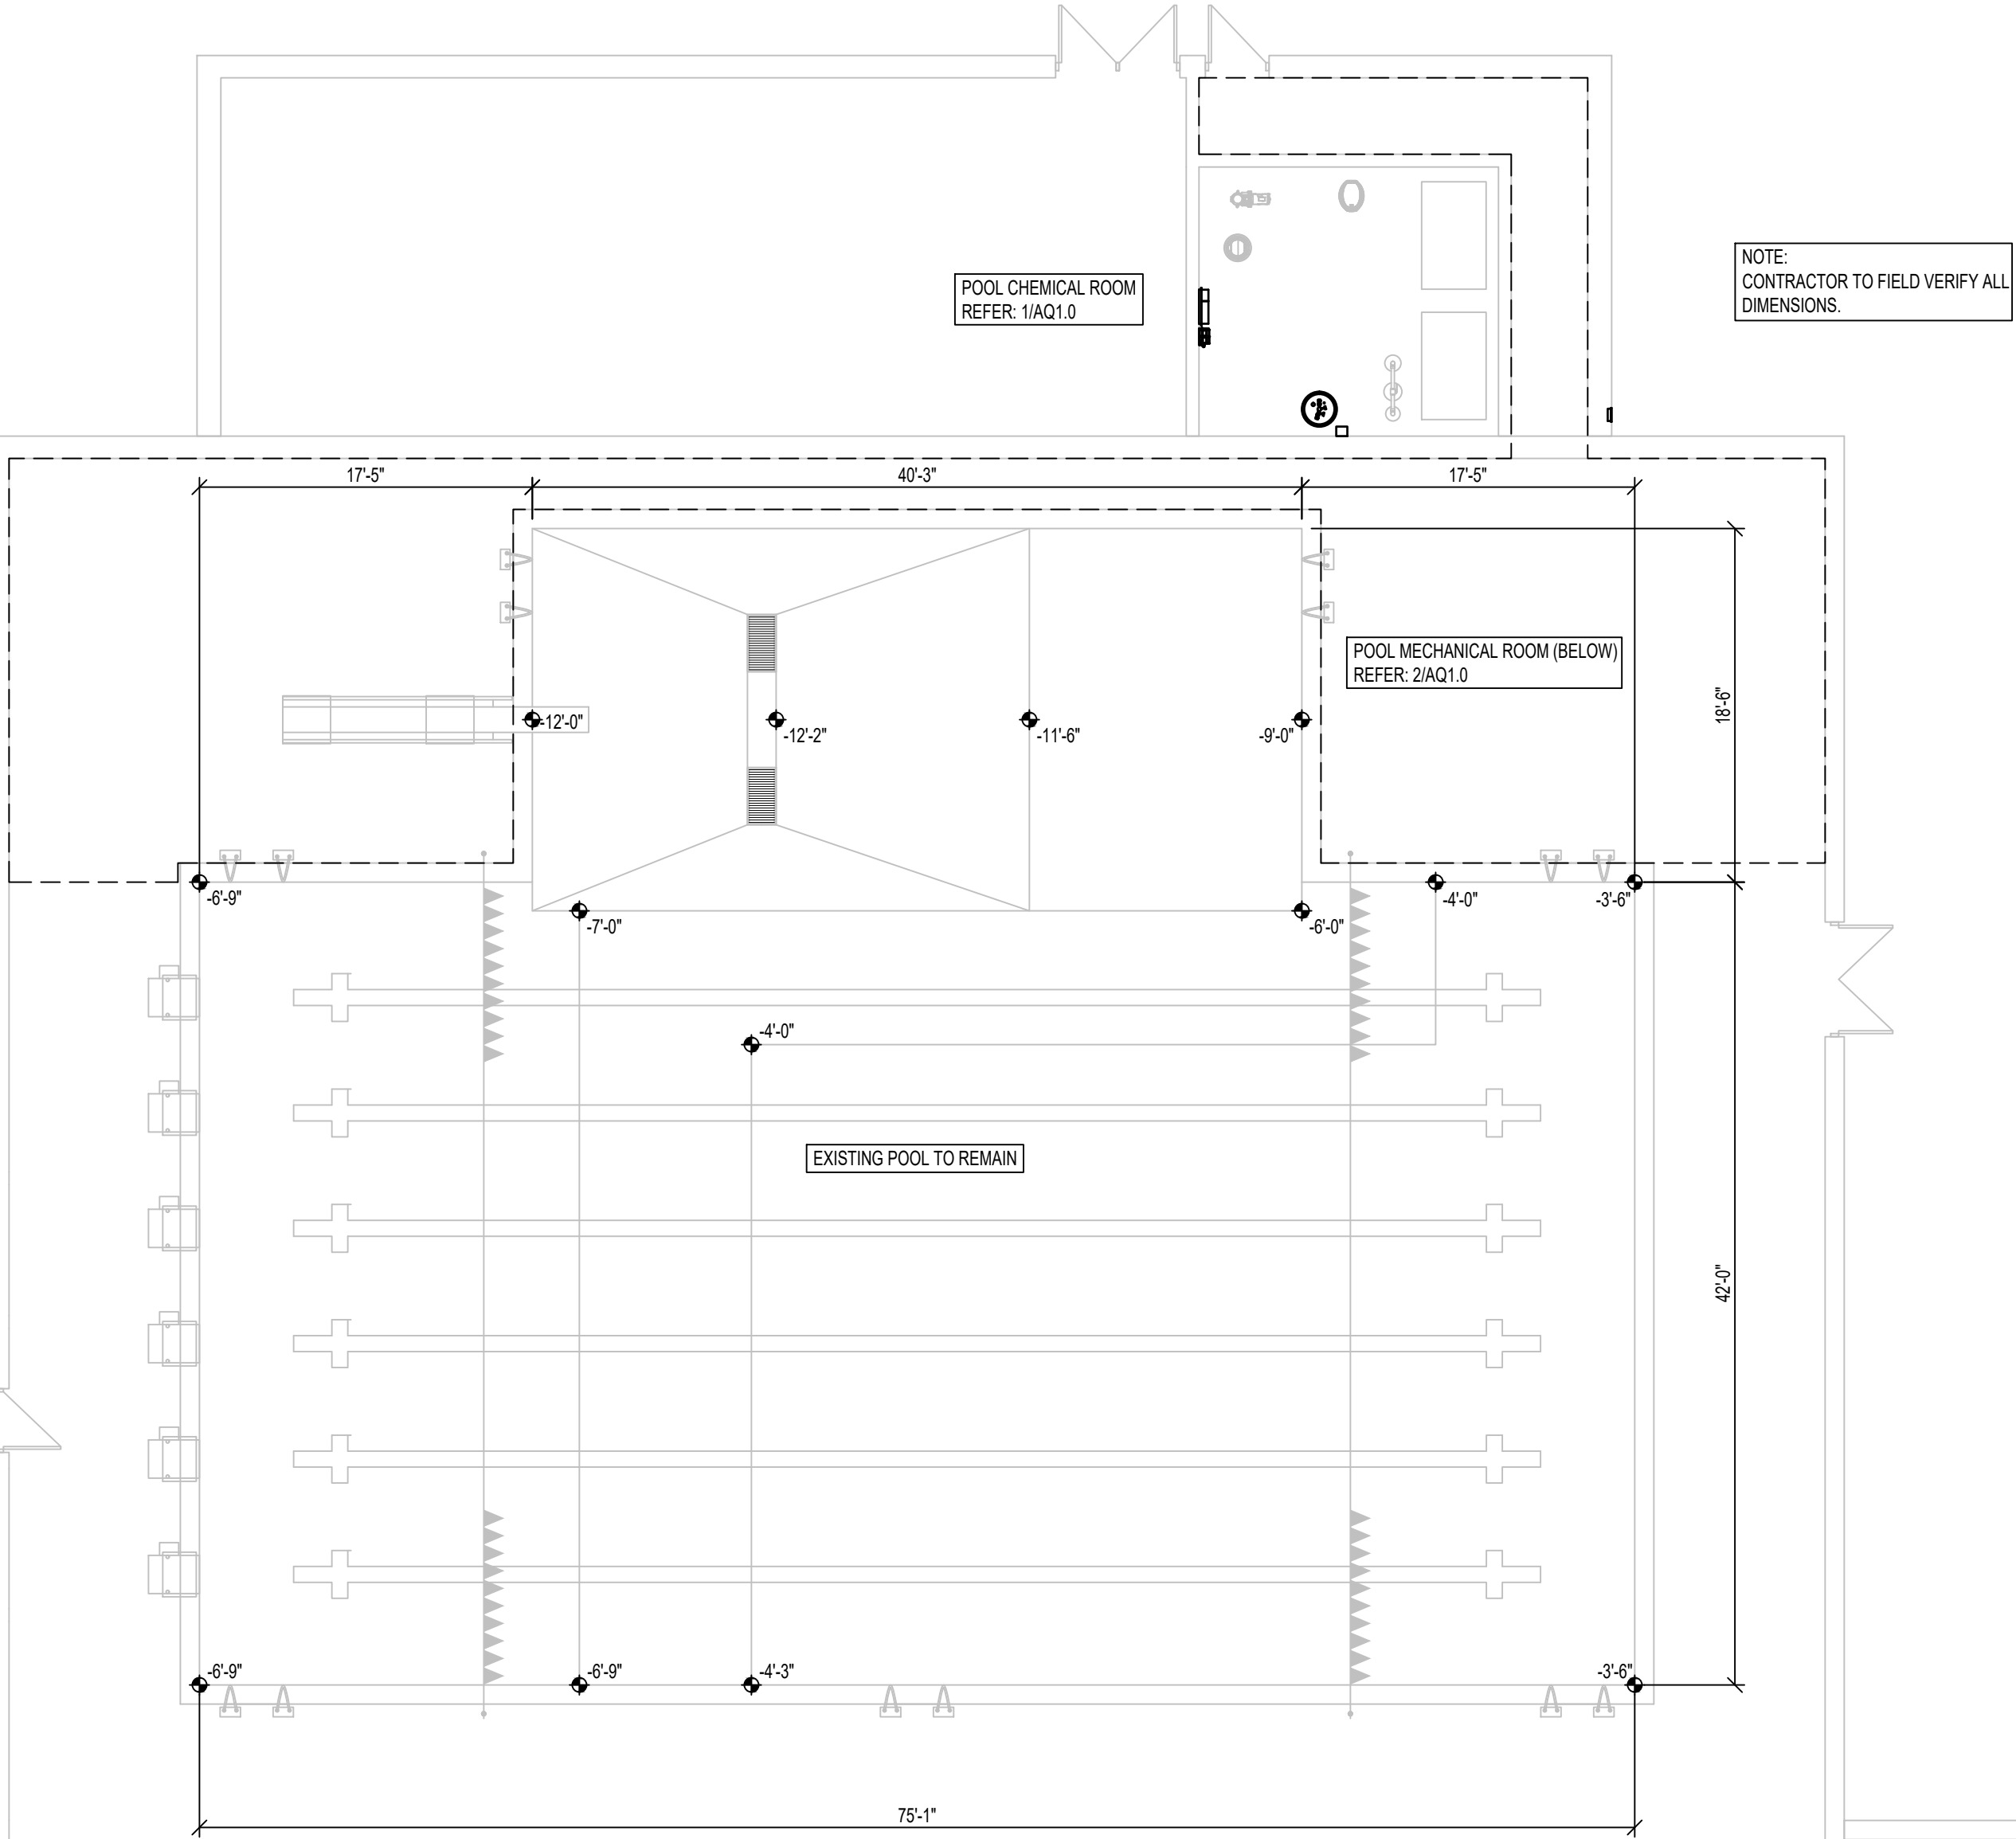

1  
AQ0.0  
POOL REFERENCE PLAN  
1/8" = 1'-0"



GENERAL POOL DEMOLITION AND RENOVATION NOTES

1.

COORDINATE ALL DEMOLITION PLANS AND WORK WITH ARCHITECT AND CONSTRUCTION DOCUMENTS PRIOR TO THE START OF DEMOLITION.

2.

REVIEW RECORD DOCUMENTS OF EXISTING CONSTRUCTION PROVIDED BY THE OWNER. NEITHER THE OWNER NOR ENGINEER MAKES ANY GUARANTEE THAT THE EXISTING CONDITIONS REFLECT THOSE INDICATED IN THE RECORD DOCUMENTS. CONTRACTOR TO PROVIDE NOTIFICATION OF ANY DISCREPANCIES BETWEEN EXISTING CONDITIONS AND THE CONTRACT DOCUMENTS BEFORE PROCEEDING WITH DEMOLITION.

3.

CONTRACTOR TO SURVEY EXISTING CONDITIONS AND CORRELATE WITH REQUIREMENTS INDICATED IN THE CONTRACT DOCUMENTS TO DETERMINE THE EXTENT OF DEMOLITION REQUIRED. CONTRACTOR TO RECORD EXISTING CONDITIONS WITH DETAILED PRECONSTRUCTION PHOTOGRAPHS.

4.

UNLESS OTHERWISE INDICATED, DEMOLITION WASTE BECOMES PROPERTY OF THE CONTRACTOR.

5.

EXCEPT FOR ITEMS OR MATERIALS INDICATED TO BE RECYCLED, REUSED, SALVAGED, REINSTALLED, OR OTHERWISE INDICATED TO REMAIN OWNERS PROPERTY, REMOVE DEMOLISHED MATERIALS FROM PROJECT SITE AND LEGALLY DISPOSE OF THEM. OWNER HAS THE FIRST RIGHT OF REFUSAL ON ALL DEMOLITION MATERIALS.

6.

IF HAZARDOUS MATERIALS ARE ENCOUNTERED, DO NOT DISTURB. IMMEDIATELY NOTIFY THE OWNER AND ENGINEER.

7.

INDICATE RECEIPT AND ACCEPTANCE OF ANY HAZARDOUS WASTES BY A LANDFILL FACILITY LICENSED TO ACCEPT SUCH HAZARDOUS WASTES.

8.

MAINTAIN EXISTING UTILITIES TO REMAIN IN SERVICE AND PROTECT THEM AGAINST DAMAGE DURING DEMOLITION OPERATIONS. REFER TO OTHER TRADES FOR COORDINATION.

9.

ELECTRICIAN MUST VERIFY EXISTING BOND GRID. ALL NEW EMBEDS AND MECHANICAL EQUIPMENT MUST BE BONDED AND TIED TO EXISTING GRID PER NEC ARTICLE 680. REFER TO ELECTRICAL.

10.

PROTECT ALL EXISTING POOL FINISHES, GUTTERS, MAIN DRAINS, AND ANY OTHER POOL RELATED APPURTENANCES DURING CONSTRUCTION.

11.

THE CONTRACTOR MUST BE RESPONSIBLE FOR CONTINUOUSLY MONITORING GROUNDWATER LEVELS ON THE SITE DURING ANY AND ALL PERIODS WHEN THE SWIMMING POOL IS NOT FULL OF WATER. PROTECTION OF THE EXISTING POOL STRUCTURE FROM DAMAGE DUE TO HYDROSTATIC PRESSURE IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR.

12.

CONTRACTOR TO PROVIDE AND EXECUTE APPROVED DUST CONTROL PLAN.

13.

ALL AREAS OF WORK MUST HAVE DOUBLE CONTAINMENT AND DEDICATED EXHAUST INDEPENDENT OF HVAC.

14.

CLEAN ADJACENT STRUCTURES AND IMPROVEMENTS OF DUST, DIRT, AND DEBRIS FOLLOWING DEMOLITION OPERATIONS. CONTRACTOR TO RETURN ADJACENT AREAS TO CONDITION EXISTING BEFORE THE START OF DEMOLITION OPERATIONS.

K

G

H

J

D

E

F

A

B

C

ISSUE DATE

12/10/2025

ISSUED FOR

BIDS

DRAWN

ZRW

CHECKED

MJM

APPROVED

CPN

STATE OF MICHIGAN

CARL P. NYLANDER

ENGINEER

NO. 650108625

PROFESSIONAL SEAL

POOL DEMOLITION KEYNOTES

COORDINATE ALL DEMOLITION PLANS WITH ARCHITECT AND CONSTRUCTION DOCUMENTS PRIOR TO DEMOLITION

D1

REMOVE EXISTING SAND FILTERS AND FACE PIPING.  
REFER: 2/AQ0.2

D2

REMOVE EXISTING RECIRCULATION PUMPS, STRAINER AND HOUSEKEEPING PADS. REFER: 1/AQ0.2

D3

REMOVE EXISTING FLOW METER SENSOR

D4

REMOVE EXISTING UV CHAMBER AND CABINET.  
REFER: 4/AQ0.2

D5

REMOVE EXISTING CHEMICAL CONTROLLER.  
REFER: 2/AQ0.3

D6

REMOVE TWO EXISTING FISHER VALVES.  
REFER: 5 & 6/AQ0.2

D7

REMOVE EXISTING FLOAT VALVE IN SURGE TANK.

D8

REMOVE MECHANICAL ROOM PIPING, VALVES, HANGERS AND SUPPORTS.

D9

REMOVE EXISTING PERISTALTIC FEED PUMP AND ANY ASSOCIATED PIPING.

**FRENCH**

2851 High Meadow Circle | Suite 100  
Auburn Hills | MI 48326  
248.656.1377

PROJECT

Livonia Public Schools  
Franklin High School  
Pool Filtration Project

Livonia,  
Michigan

SHEET

Unit Q  
POOL MECHANICAL  
& CHEMICAL ROOM  
DEMOLITION PLANS

PROJECT NUMBER

2025-042.2

SHEET NUMBER

AQ0.1

COUNSLIMAN•HUNSAKER

AQUATICS FOR LIFE

ph: 314.894.1245 • www.chh2o.com

1

AQ0.1

3/8" = 1'-0"

POOL CHEMICAL ROOM DEMOLITION PLAN (MAIN FLOOR)

2

AQ0.1





3/16" = 1'-0"

POOL MECHANICAL ROOM DEMOLITION PLAN (LEVEL BELOW)

© 2025 COUNSLIMAN • HUNSAKER

2025-042.2 LPS Franklin HS - Pool Filtration Project



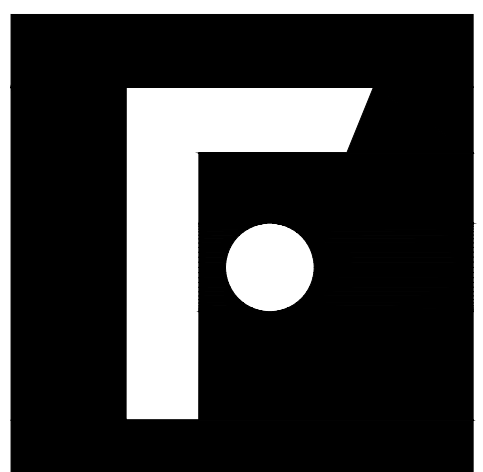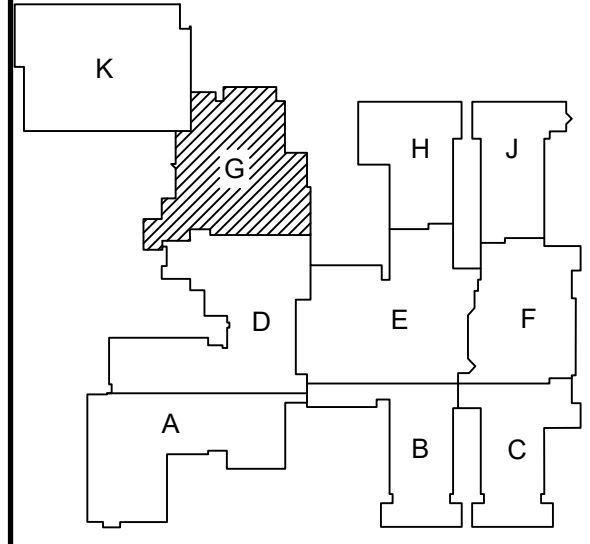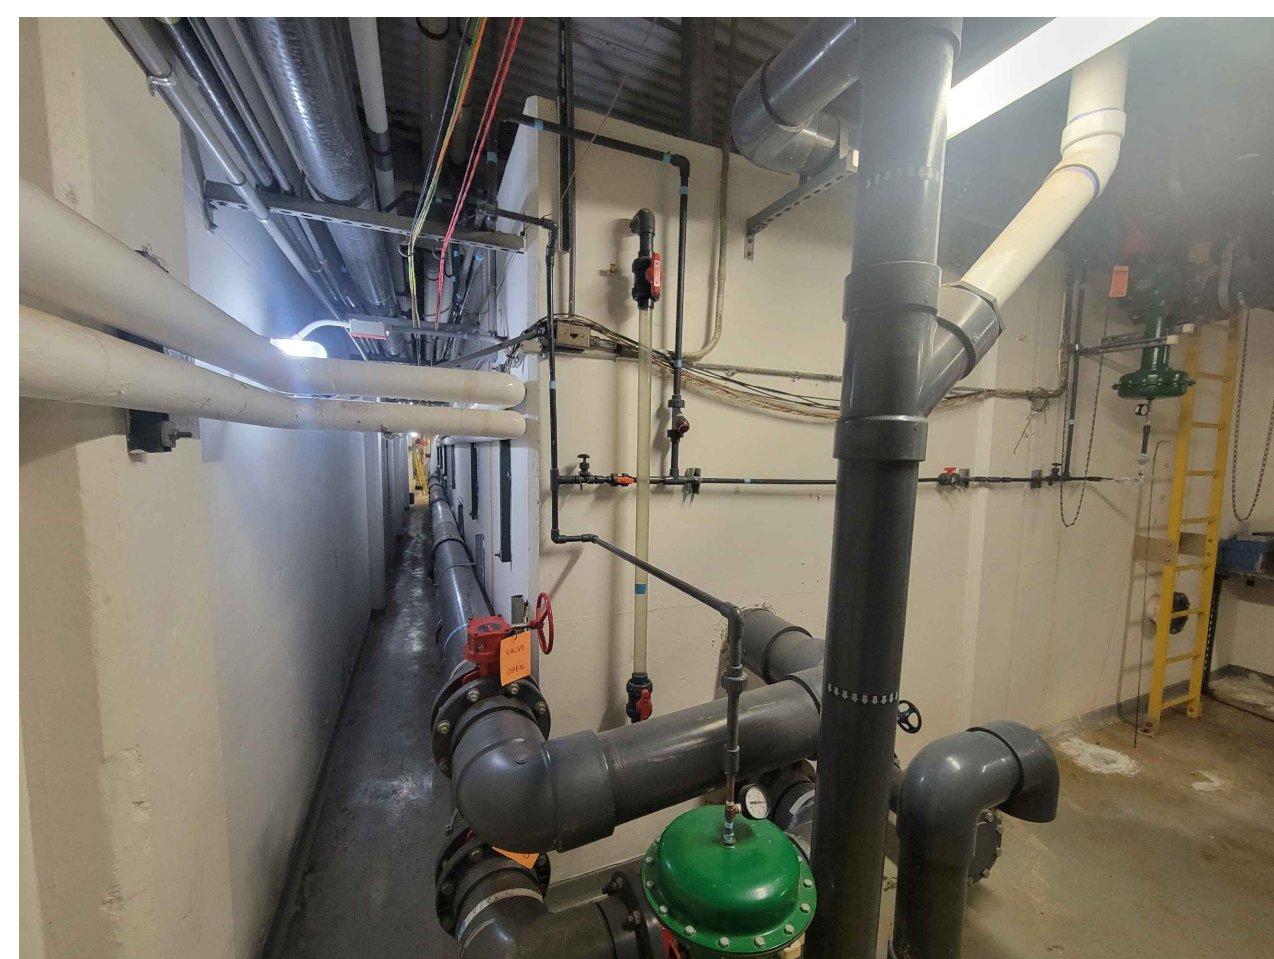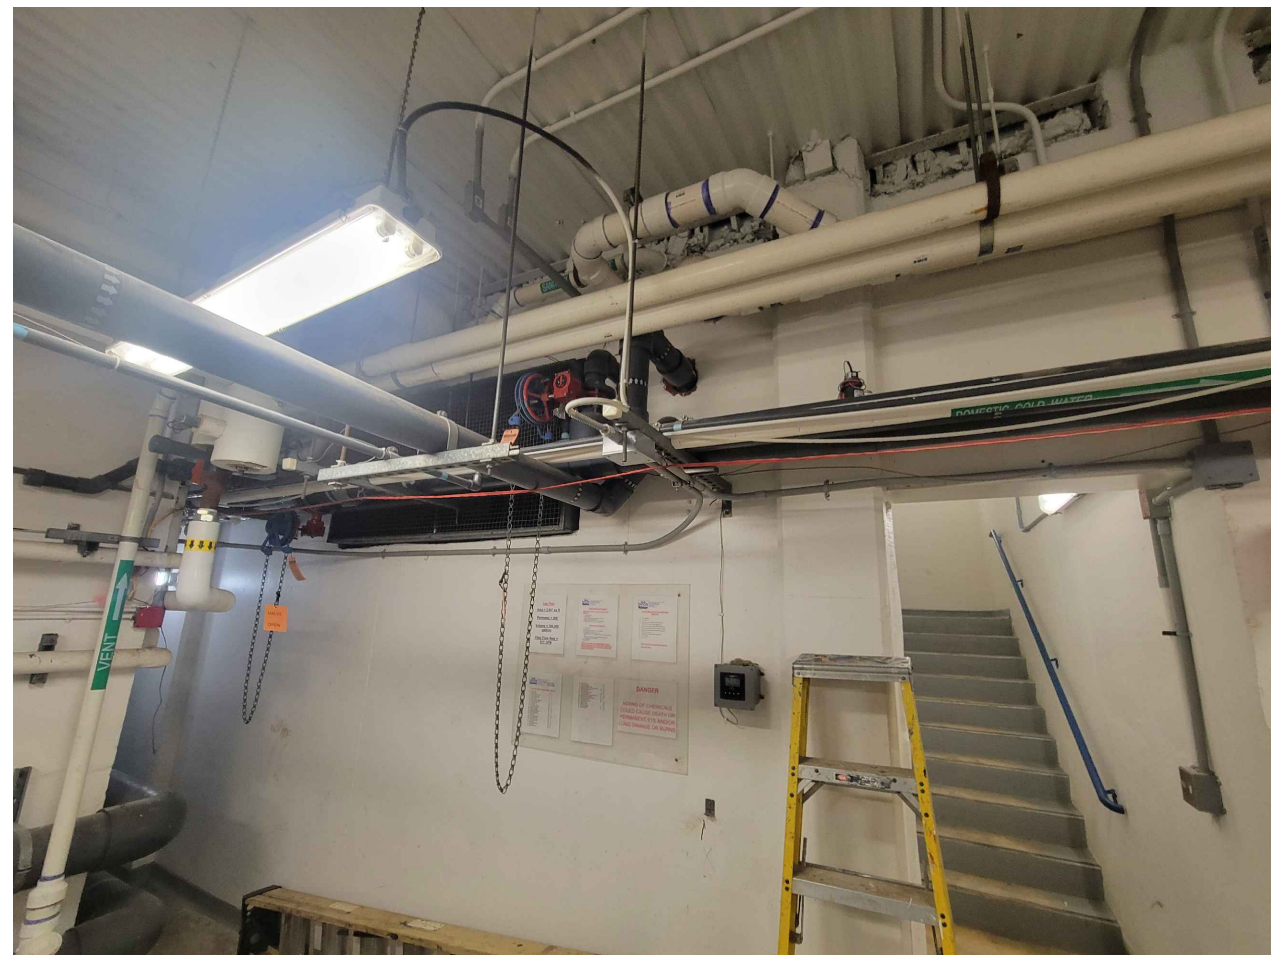

2851 High Meadow Circle | Suite 100  
Auburn Hills | MI 48326  
248.656.1377

PROJECT

Livonia Public Schools  
Franklin High School  
Pool Filtration Project

Livonia,  
Michigan

SHEET

Unit Q  
POOL MECHANICAL  
ROOM EXISTING  
CONDITIONS

PROJECT NUMBER




2025-042.2

SHEET NUMBER

## AQ0.2





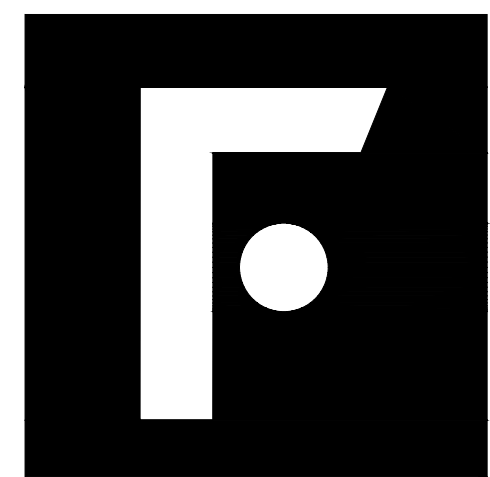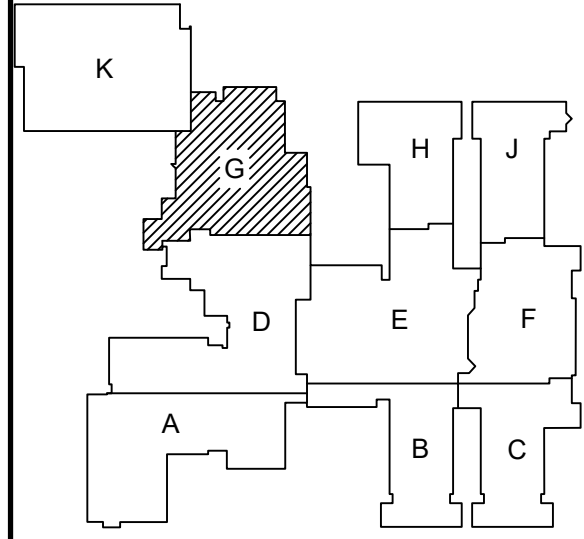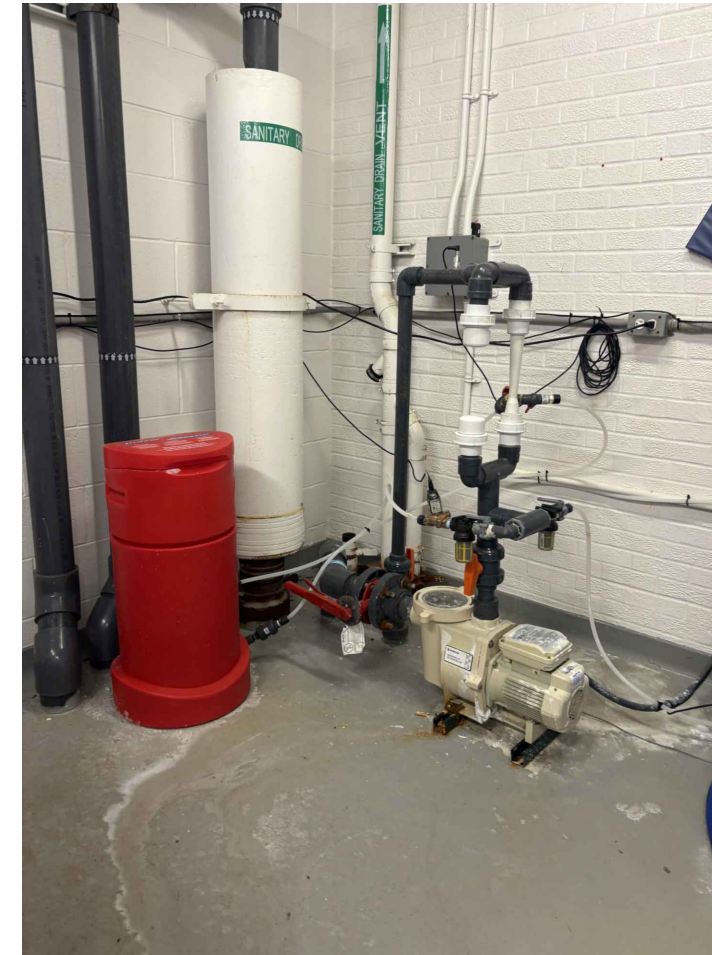

2851 High Meadow Circle | Suite 100  
Auburn Hills | MI 48326  
248.656.1377

PROJECT

Livonia Public Schools  
Franklin High School  
Pool Filtration Project

Livonia,  
Michigan

SHEET

Unit Q  
POOL CHEMICAL  
ROOM EXISTING  
CONDITIONS

PROJECT NUMBER


2025-042.2

SHEET NUMBER


### AQ0.3






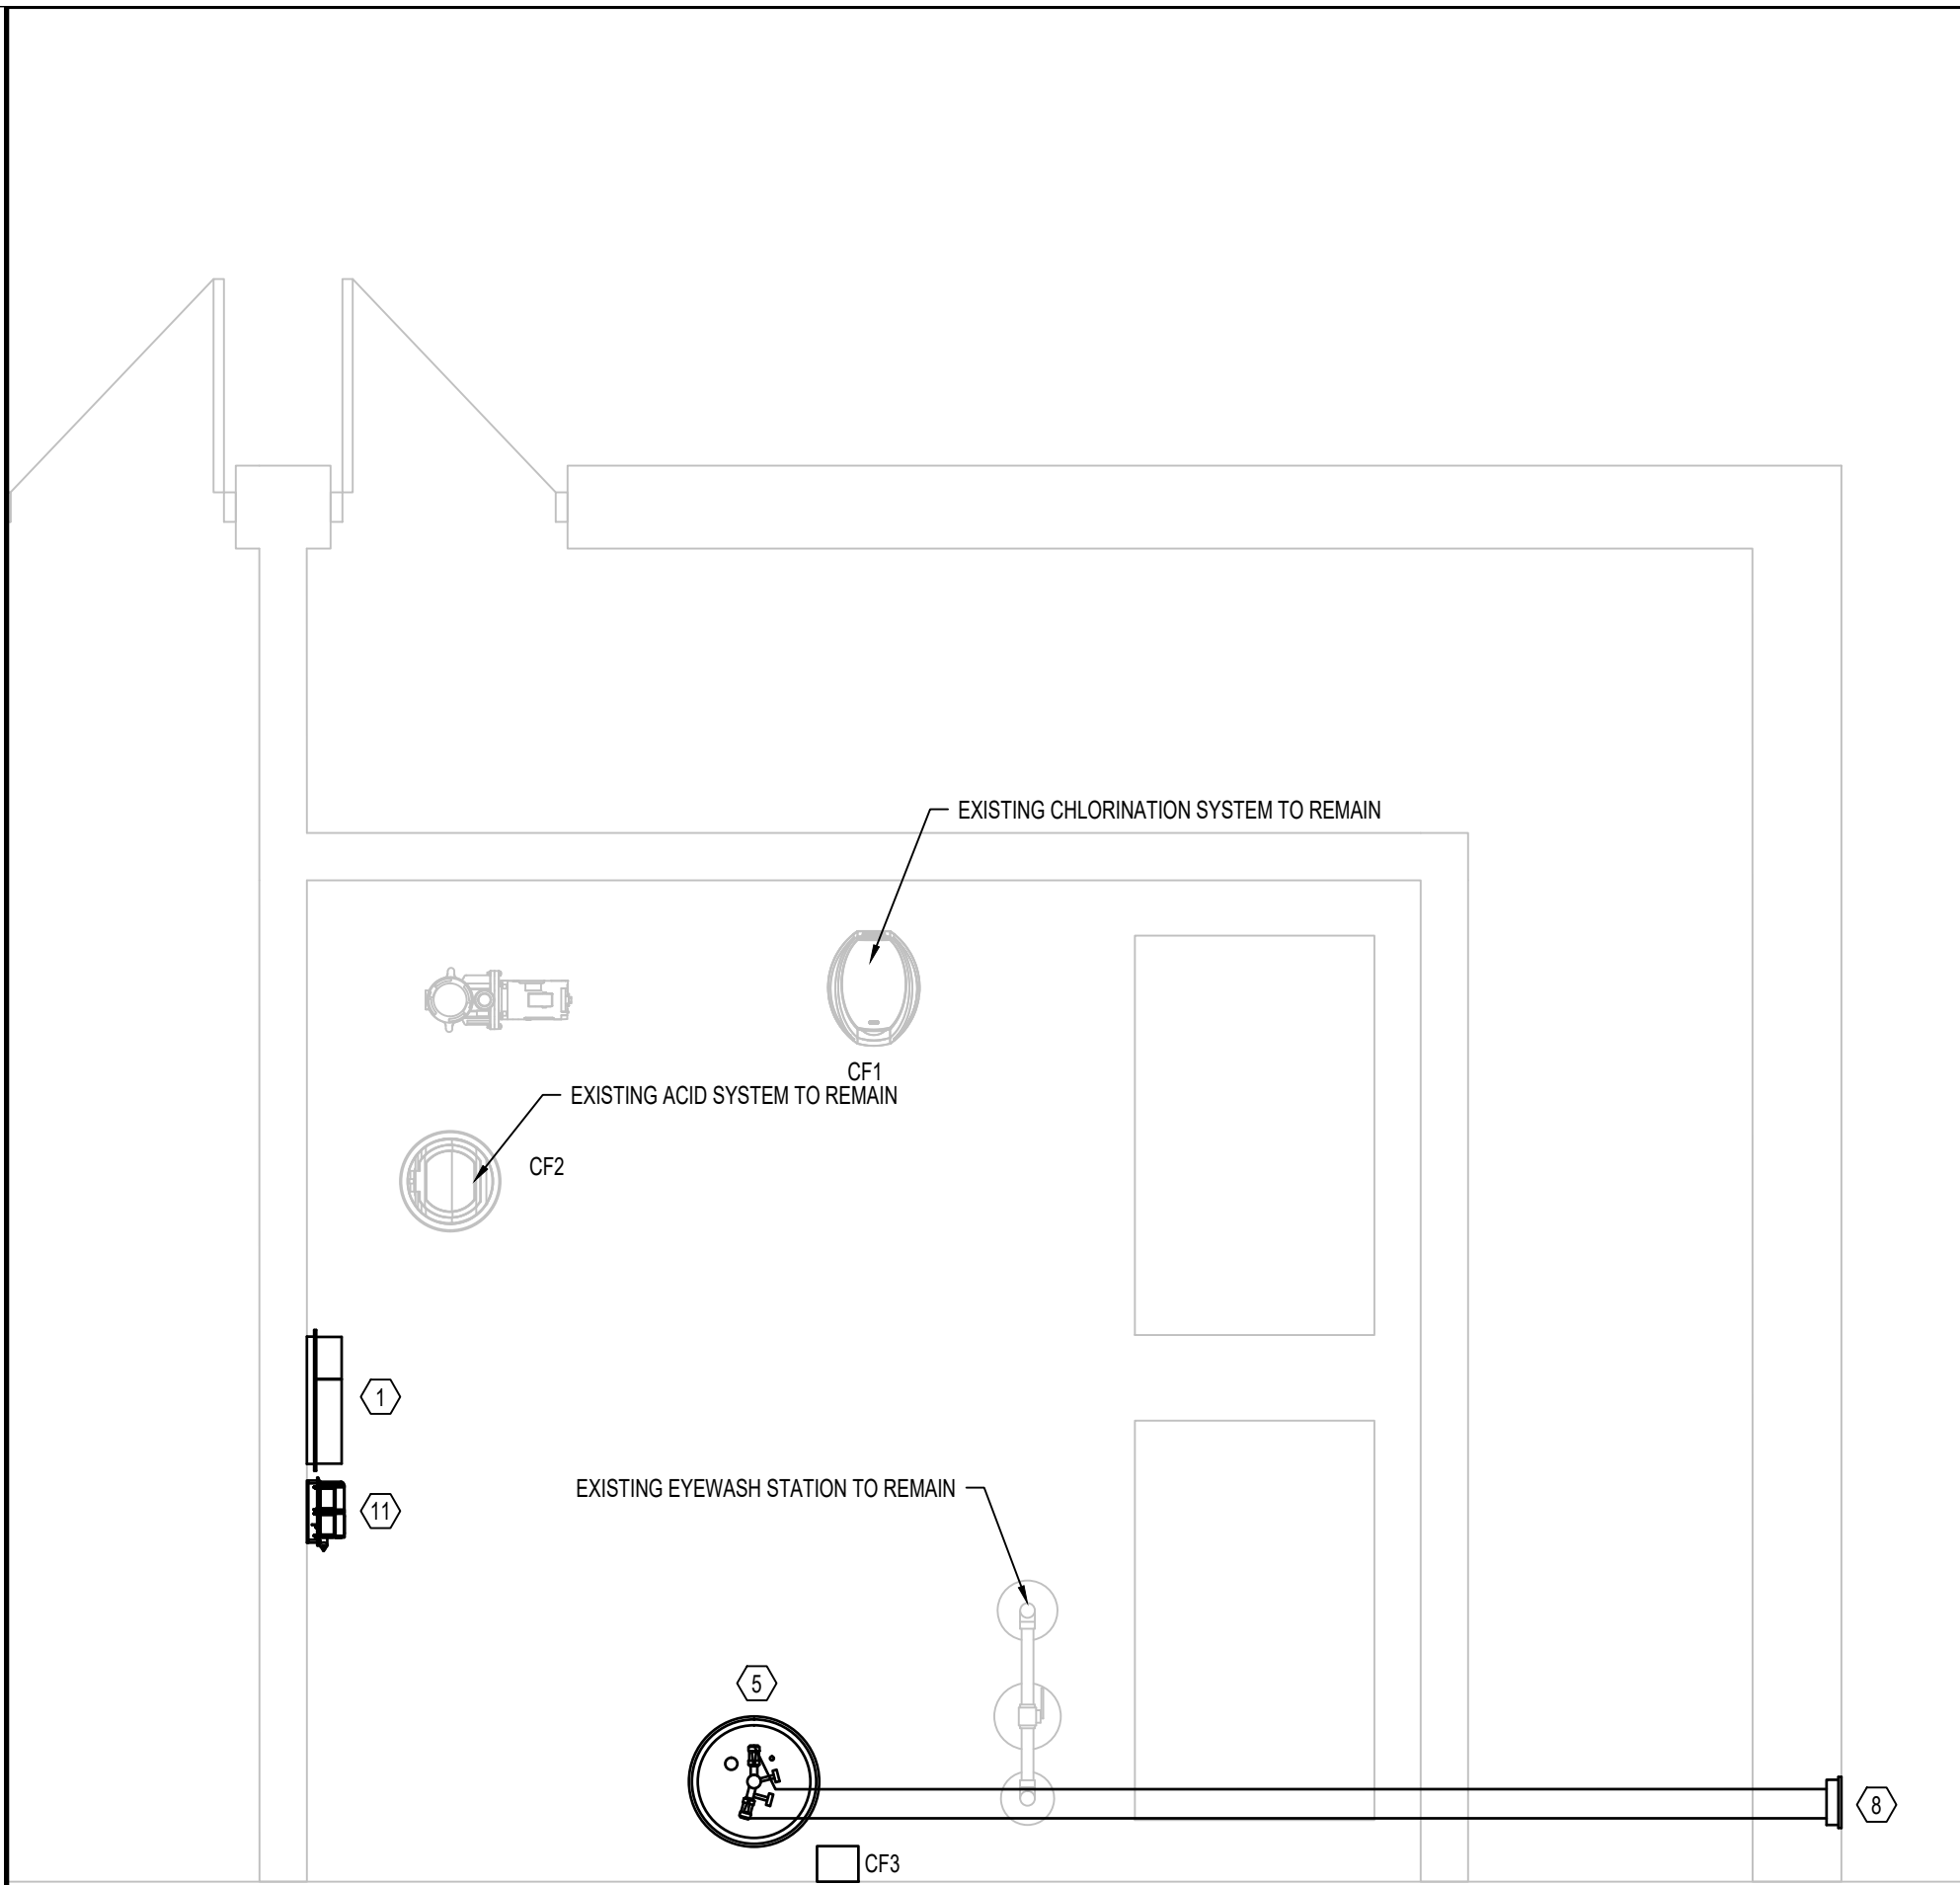

1  
AQ1.0  
3/8" = 1'-0"

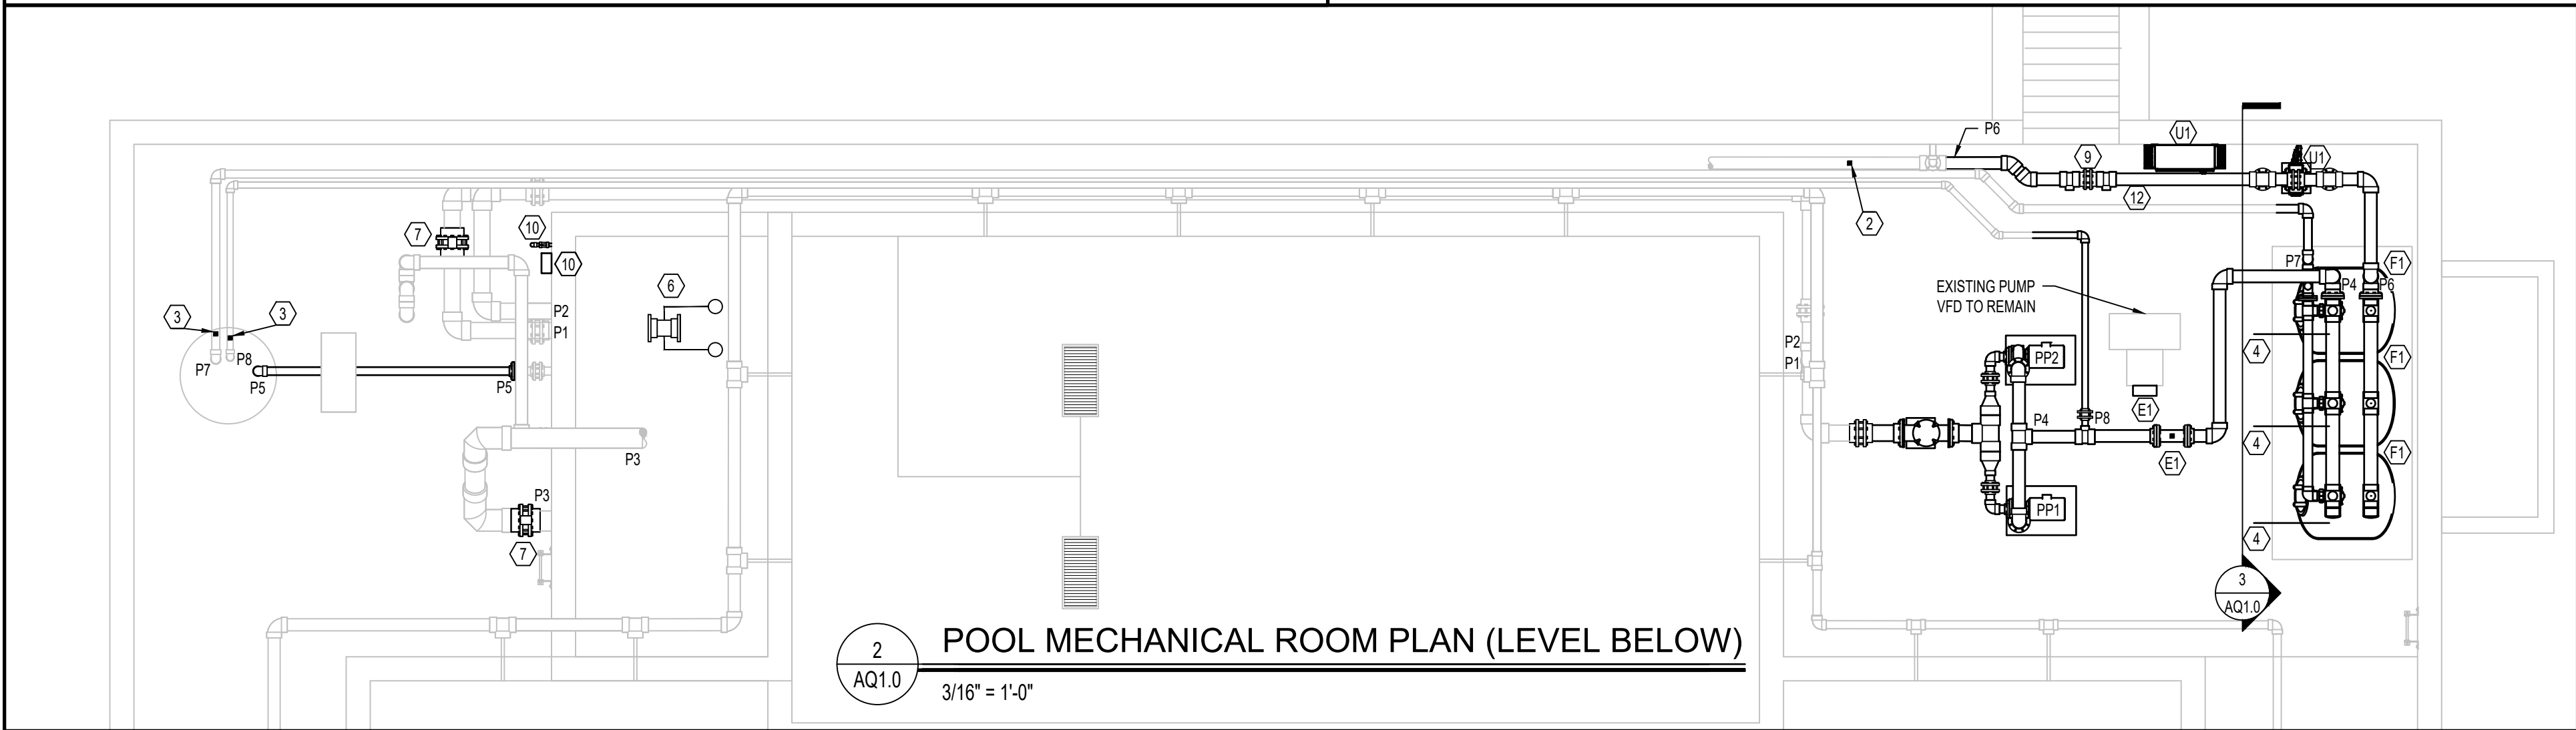

2  
AQ1.0  
3/16" = 1'-0"

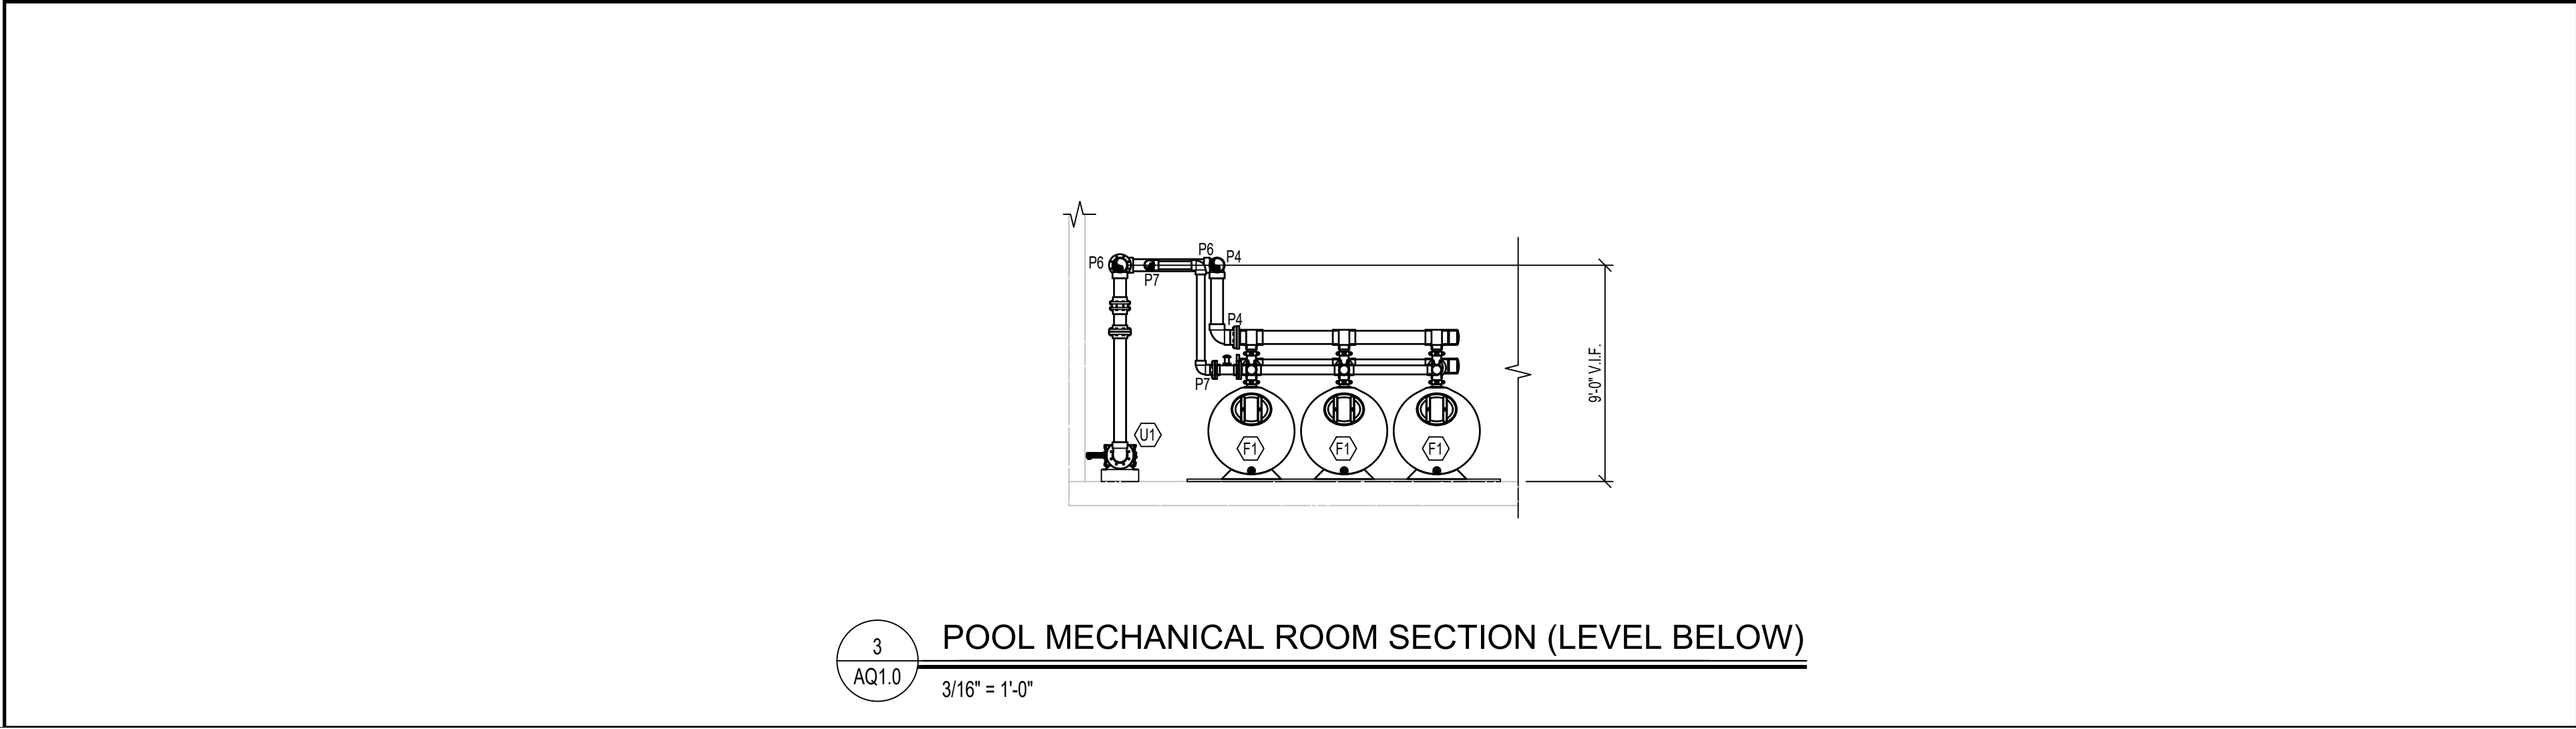

3  
AQ1.0  
3/16" = 1'-0"

CHEMICAL FEED SCHEDULE						
ID	DESCRIPTION	MANUFACTURER	MODEL	HP	FLOW	NOTES
CF1	EXISTING POOL CHLORINATION BOOSTER PUMP TO REMAIN	PULSAR	PRECISION	1	189 LBS/DAY	4
CF2	EXISTING POOL ACID FEED PUMP TO REMAIN	PULSAR	ACID PLUS		60 LBS/DAY	4
CF3	EXISTING POOL CO2 FEED REFER: 3/AQ1.1	PROMINENT	CO2-200	N/A	20-200 SCFH	1-3
NOTE: 1. THE MANUFACTURER INDICATED IS BASIS OF DESIGN. ALTERNATE MANUFACTURER: PROMINENT, BECS, EK03 OR APPROVED EQUAL. 2. PROVIDE WITH 120 VOLT, SINGLE PHASE, ADJUSTABLE FEED. 3. INTERLOCK WITH POOL RECIRCULATION PUMP. 4. PROVIDE WITH AN ADDITIONAL 1 HP WHISPERFLO FEED PUMP TO MATCH EXISTING FOR ATTIC STOCK.						

UV TREATMENT SYSTEMS SCHEDULE						
ID	POOL	MODEL NUMBER	CALCULATED 60 MJ/CM2 (GPM)	LAMPS	POWER (KW)	VOLTAGE (V) WITH BREAKER SIZE (50 OR 60 HZ)
U1	EXISTING POOL	WF-125-6-N	616	1 @ 2.9KW	2.5	240 V (1Ø) 30A
NOTE: 1. THE BASIS OF DESIGN MANUFACTURER IS EVOQUA TECHNOLOGIES LTD. ALTERNATE MANUFACTURER: PROMINENT, AQUIONICS OR APPROVED EQUAL. 2. INTERLOCK UV SYSTEM WITH CHEMICAL CONTROLLER OR RECIRCULATION PUMP. 3. REFER: 6/AQ1.1						

EQUIPMENT SCHEDULE					
ID	ITEM		ID	ITEM	
1	CHEMICAL CONTROLLER REFER: 2/AQ1.1		7	ELECTRICALLY ACTUATED VALVE REFER: 8/AQ1.2	
2	FLOW METER SENSOR REFER: 8/AQ1.1		8	CO2 FILLBOX REFER: 5/AQ1.1	
3	IMPACT FLOW METER REFER: 9/AQ1.1		9	HEATER TEES REFER: 9/AQ1.2	
4	HARD PIPE TO DRAIN		10	WATER LEVEL CONTROLLER REFER: 11/AQ1.1	
5	CO2 TANK REFER: 3/AQ1.1		11	TOTAL ALKALINITY PANEL REFER: 10/AQ1.2	
6	8" FLOAT VALVE REFER: 12/AQ1.2		12	CHEMICAL INJECTION REFER: 7/AQ1.1	

GENERAL POOL MECHANICAL ROOM NOTES	
1. THE FOLLOWING INFORMATION SHALL BE LAMINATED AND POSTED IN THE POOL MECHANICAL ROOM: BACKWASH PROCEDURE, POOL FILLING & DRAINING, VALVE REFERENCE CHART, POOL MECHANICAL ROOM PLAN, POOL PIPING SCHEMATICS & POOL SYSTEMS SCHEMATICS.	
PIPING	
1. MINIMUM 7'-0" CLEARANCE BENEATH ALL OVERHEAD PIPING.	
2. PROVIDE AND SUPPORT OVERHEAD AND VERTICAL PIPING PER SPECIFICATION REQUIREMENTS.	
3. LABEL AND IDENTIFY ALL PIPING IN COMPLIANCE WITH THE SPECIFICATIONS.	
4. ALL FLOW METERS SHALL BE SIZED TO MATCH THE PIPE ON WHICH IT IS INSTALLED. PROVIDE PRESSURE GAUGES ON INFLUENT AND EFFLUENT SIDE OF EACH FILTRATION SYSTEM AND A FULL LINE SIZE FLOW METER ON FILTER RETURN.	
5. HYDROSTATICALLY TEST ALL PIPING AT 50 PSI FOR TWO HOURS AND MAINTAIN A PRESSURE OF 20 PSI IN ALL PIPING THROUGHOUT CONSTRUCTION. SECURE ALL FIXTURES PER SPECIFICATION REQUIREMENTS BEFORE HYDROSTATIC TEST.	
6. REFER TO DETAILS 2-7/AQ1.2 FOR INSTALLATION OF PIPE SUPPORTS.	
7. ALL VALVE HARDWARE MUST BE 316L STAINLESS STEEL AND MEET ANSI HARDWARE INSTALLATION GUIDELINES. REFER: 10/AQ1.1	
CHEMICAL TREATMENT	
1. CHEMICAL FEED REQUIREMENTS - REFER TO THE POOL SYSTEMS SCHEMATIC(S) ON AQ2.0.	
2. INTERLOCK POOL RECIRCULATION PUMP(S) WITH ITS CORRESPONDING WATER CHEMISTRY CONTROLLER, CHEMICAL FEED PUMP(S), AND HEATER(S).	
3. PROVIDE SIGNAGE ON CHEMICAL ROOM DOORS IN COMPLIANCE WITH THE STATE FIRE CODE. REFER: 11/AQ1.2	
4. SECURE CHEMICAL METERING PUMP FEED LINES TO WALL AND/OR OVERHEAD WITH CLIPS OR DEVICES THAT DO NOT CRIMP, DISTORT OR ALLOW HIGH AND LOW AREAS IN TUBING RUNS. PROVIDE CHECK VALVE AND SHUT-OFF VALVE BEFORE LINES ENTER POOL RETURN PIPING.	
5. WATER CHEMISTRY CONTROLLERS SHALL CONTROL THE SANITIZING SYSTEM AND PH CONTROL SYSTEM AND SHUT THEM DOWN UPON LOSS OF SAMPLE STREAM FLOW.	
6. THE CHEMICAL CONTROL SYSTEM BYPASS LINE SHALL SAMPLE WATER AFTER THE FILTERS AND BEFORE THE HEATER BYPASS LINE.	
7. VERIFY REMOTE ACCESS CAPABILITY TO ALL CHEMICAL CONTROLLERS. REFER TO ELECTRICAL.	
8. INSTALL SANITIZER INJECTION POINT DOWNSTREAM OF PH BUFFER INJECTION POINT ON FILTERED WATER RETURN PIPE. CHEMICAL INJECTION POINTS SHALL BE LOCATED DOWNSTREAM OF ALL OTHER EQUIPMENT/SYSTEMS IN THE POOL MECHANICAL ROOM AT A MAXIMUM HEIGHT OF 7'-0" ABOVE FINISHED FLOOR. REFER: 7/AQ1.1	
ELECTRICAL	
1. GFCIS PROVIDED AT OUTLETS. REFER TO ELECTRICAL.	
2. POOL EQUIPMENT ROOM AND CHEMICAL STORAGE AREAS SHALL BE PROVIDED WITH ARTIFICIAL LIGHTING SUFFICIENT TO ILLUMINATE ALL EQUIPMENT AND SUPPLIES. REFER TO ELECTRICAL.	
3. CONDUIT SHALL BE ROUTED OVERHEAD OR BELOW GRADE.	

FILTER SCHEDULE											
ID	POOL	MANUFACTURER	FILTER MODEL	QTY.	FILTRATION TYPE	MAXIMUM FILTRATION RATE (GPM/SQ. FT.)	REQUIRED FILTRATION AREA (SQ. FT.)	DESIGN FILTRATION RATE (GPM/SQ. FT.)	DESIGN FILTRATION AREA (SQ. FT.)	FILTER BACKWASH RATE (GPM/SQ. FT.)	BACKWASH FLOW RATE PER FILTER (GPM)
F1	EXISTING POOL	STARK	S1-48	3	HIGH RATE PRESSURE	13.5	38.3	13.5	38.4	15.7	201
NOTE: 1. BACKWASH METHOD MUST BE MANUAL. 2. ALL FILTER SUPPORTS MUST BE SEISMICALLY RATED FOR THE SEISMIC ZONE IN WHICH IT IS INSTALLED IN ACCORDANCE WITH LOCAL AND/OR STATE REQUIREMENTS. 3. FILTER MANUFACTURER MUST CERTIFY FILTER MEDIA. 4. VALVES MUST BE PROVIDED TO BACKWASH EACH FILTER VESSEL INDEPENDENTLY. 5. THE BACKWASH PIPING MUST TERMINATE NO CLOSER THAN 8" ABOVE THE FLOOD RIM OF THE BACKWASH CATCH BASIN OR TWICE THE PIPE DIAMETER, WHICHEVER IS GREATER. 6. FILTER TANK ASSEMBLIES MUST BEAR THE NATIONAL SANITATION FOUNDATION SEAL OF APPROVAL FOR A MAXIMUM FLOW RATE 20 GPM PER SQUARE FOOT OF FILTER MEDIA. 7. THE BACKWASH THROTTLING VALVE(S) HANDLE MUST BE REMOVED AND TURNED OVER TO THE OWNER ONCE THE BACKWASH FLOW RATE(S) HAVE BEEN TESTED, ADJUSTED AND BALANCED. 8. PROVIDE 1" DIAMETER, SCHEDULE 80 PIPE FROM THE AUTOMATIC AIR VENT ON EACH OF THE FILTER VESSEL TO THE NEAREST FLOOR DRAIN OR BACKWASH CATCH BASIN. THE VENT PIPE MUST BE SLOPED TO THE DRAIN. 9. VESSEL MUST BE BACKWASHED AT NO LESS THAN 15.0 GPM/SF.											

PUMP SCHEDULE											
ID	DESCRIPTION	MANUFACTURER	MODEL	SIZE	GPM	TDH	HP	NPSHR	HAIR & LINT		NOTES
									MAKE	SIZE	
PP1	EXISTING POOL RECIRCULATION PUMP 1 REFER: 1/AQ1.1	AURORA	3801	3'X4'X9.5	517	75	20	7.34	MER-MADE	8'X8"	1-6
PP2	EXISTING POOL RECIRCULATION PUMP 2 REFER: 1/AQ1.1	AURORA	3801	3'X4'X9.5	517	75	20	7.34			1-6
NOTE: 1. THE MANUFACTURER INDICATED IS BASIS OF DESIGN. PUMP MANUFACTURERS: GRISWOLD, HERBORNER, OR PACO MUST BE CONSIDERED EQUAL PROVIDED THEY MEET SPECIFICATIONS AS INDICATED IN BID DOCUMENTS. 2. POOL PUMPS AND STRAINERS MUST BE INSTALLED ON HOUSEKEEPING PADS. 3. PROVIDE INFLUENT AND EFFLUENT GAUGES FOR EACH PUMP. PRESSURE GAUGES HAVE A RANGE OF 0-60 PSI. COMPOUND GAUGES HAVE A RANGE OF 0-30 HG / 0-60 PSI. 4. PROVIDE WITH 460 VOLT, 3 PHASE, 60HZ, 1750 RPM MOTOR. 5. PROVIDE WITH CHECK VALVE. 6. EXISTING VARIABLE FREQUENCY DRIVE TO REMAIN AND CONNECT TO NEW RECIRCULATION PUMPS.											

ELECTRONIC FLOCCULATION SYSTEM SCHEDULE								
ID	POOL	MANUFACTURER	MODEL	PIPE SIZE (NOMINAL)	INPUT VOLTAGE	POWER RATING (W)	POWER CABLE LENGTH (FT)	SIGNAL CABLE LENGTH (FT)
E1	EXISTING POOL	CLEAR-FLOW	CF-800C	8"	100-240 VAC	5.4	15	33
NOTE: REFER: 1/AQ1.3								

PIPE SCHEDULE	
ID	DESCRIPTION
P1	8" FROM EXISTING POOL MAIN DRAINS TO PP1 & PP2
P2	8" FROM EXISTING POOL SURGE TANK TO PP1 & PP2
P3	10" FROM EXISTING POOL DROPOUTS TO SURGE TANK
P4	6" FROM PP1 & PP2 TO F1
P5	4" FROM EXISTING BASIN FLANGE TO DRAIN PIT
P6	6" FROM F1 TO EXISTING POOL INLETS
P7	4" FROM F1 TO BASIN
P8	3" FROM P4 TO BASIN



K

G

H

J

D

E

F

A

B

C

ISSUE DATE

12/10/2025

ISSUED FOR

BIDS

DRAWN

ZRW

CHECKED

MJM

APPROVED

CPN

**FRENCH**  
2851 High Meadow Circle | Suite 100  
Auburn Hills | MI 48326  
248.656.1377

PROJECT  
Livonia Public Schools  
Franklin High School  
Pool Filtration Project

Livonia,  
Michigan




SHEET  
Unit Q  
POOL MECHANICAL  
& CHEMICAL ROOM  
PLANS & SECTION

PROJECT NUMBER  
2025-042.2  
SHEET NUMBER  
AQ1.0







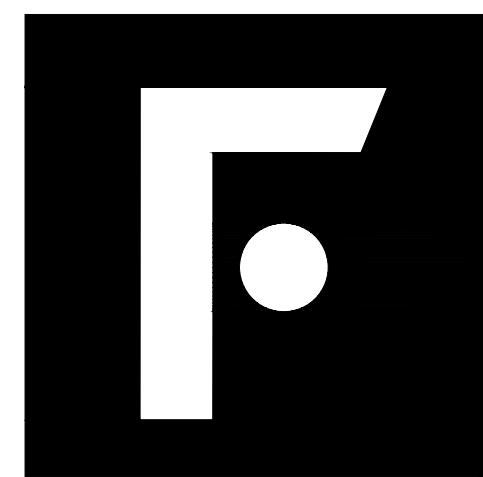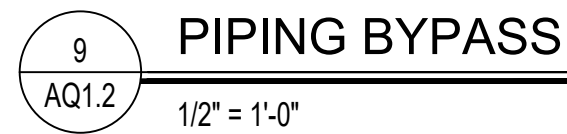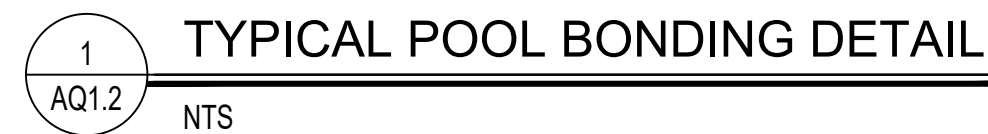

# FRENCH

**2851 High Meadow Circle | Suite 100**  
**Auburn Hills | MI 48326**  
**248.656.1377**

PROJECT

Livonia Public Schools  
Franklin High School  
Pool Filtration Project

Livonia,  
Michigan

SHEET

Unit Q  
POOL MECHANICAL  
DETAILS

PROJECT NUMBER

2025-042.2


SHEET NUMBER

## AQ1.2







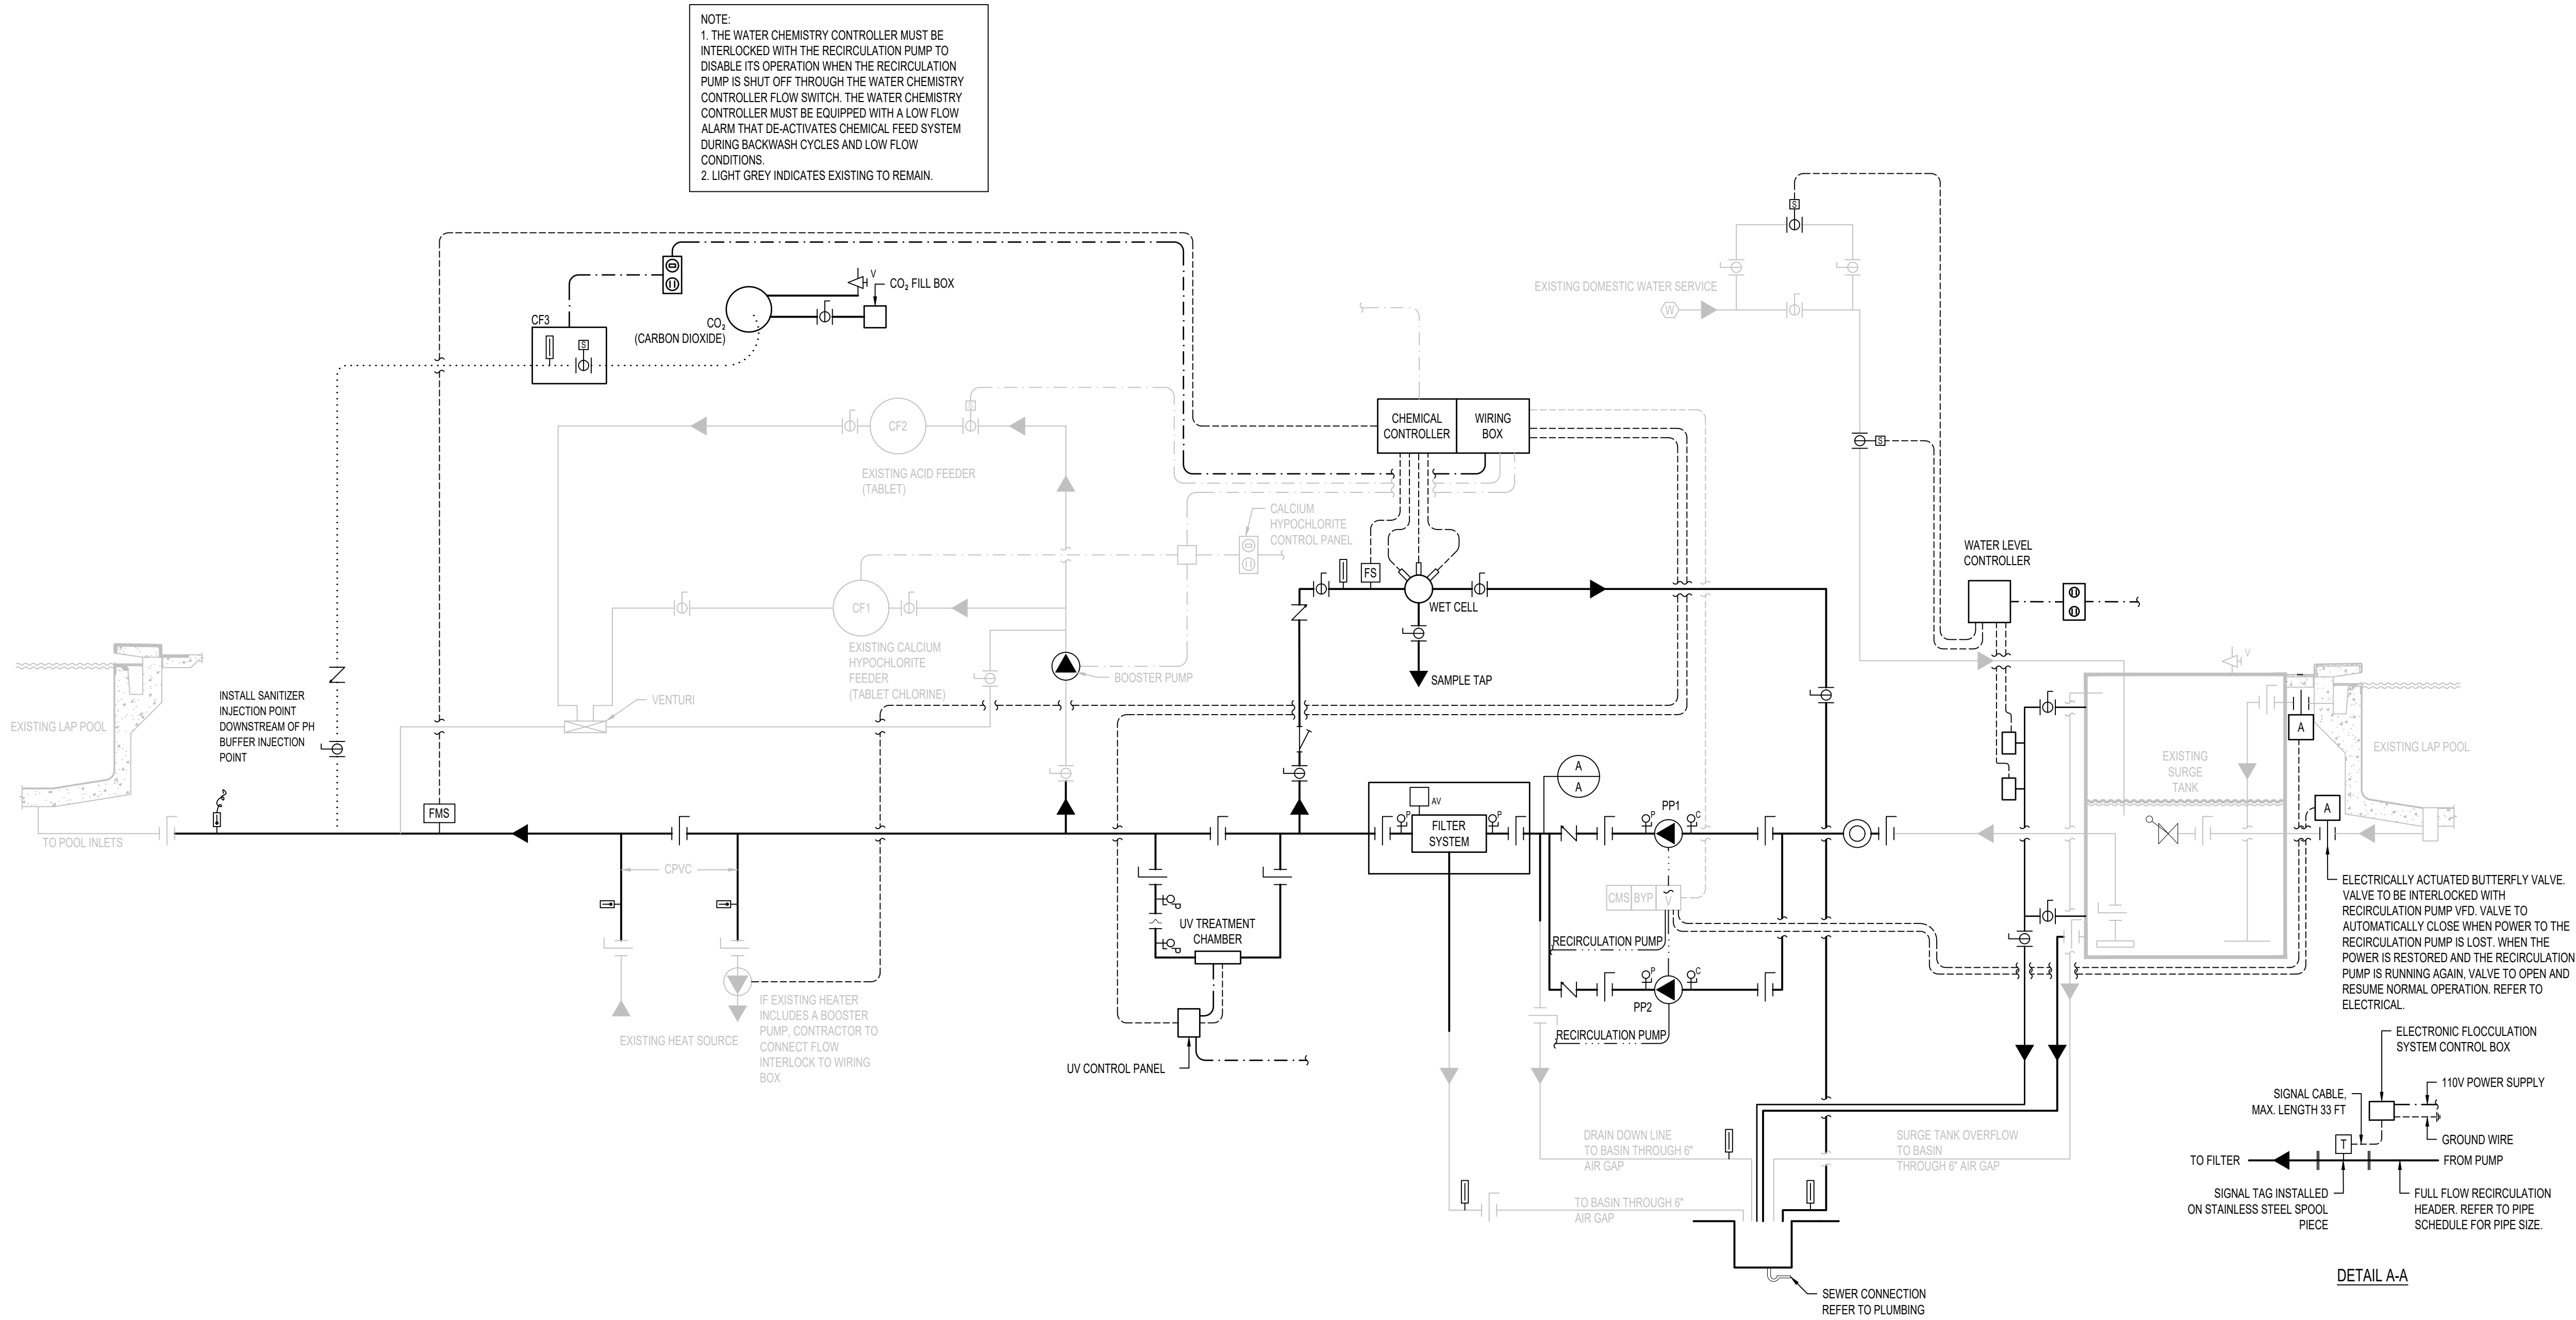

SCHEMATIC LEGEND	
LEGEND	ITEM
	FLOW DIRECTION
	BUTTERFLY VALVE
	BALL VALVE
	MODULATING FLOAT VALVE
	SOLENOID VALVE
	CHECK VALVE
	THREE WAY VALVE
	PUMP
	HAIR AND LINT STRAINER
	"Y" STRAINER
	FLOW METER SENSOR
	FLOW SWITCH
	IMPACT FLOW METER
	VENTURI FLOW METER
	WATER METER
	AUTOMATIC AIR VENT
	AIR VENT
	AIR INLET
	PRESSURE GAUGE AND PETCOCK
	COMPOUND GAUGE AND PETCOCK
	DIGITAL TEMP SENSOR
	THERMOMETER
	PNEUMATIC ACTUATOR
	FLOW CONTROL VALVE
	COMBINATION SWITCH/RECEPTACLE
	DUPLEX OUTLET
	AUTOMATIC PUMP SHUT-OFF DEVICE
	VARIABLE FREQUENCY DRIVE
	REMOTE START/STOP
	EMERGENCY STOP
	VARIABLE FREQUENCY DRIVE BYPASS
	CONTACT MOTOR SELECTOR
	ELECTRONIC FLOCCULATION SIGNAL TAG
	15 MINUTE TIMER SWITCH
	LOW VOLTAGE CONTROL
	WATER LINE
	1 PHASE POWER
	3 PHASE POWER
	CO2 LINE
	NETWORK LINE BY ELECTRICAL
	GAS LINE

ISSUE DATE	ISSUED FOR
12/10/2025	BIDS
DRAWN	ZRW
CHECKED	MJM
APPROVED	CPN

**FRENCH**

2851 High Meadow Circle | Suite 100  
Auburn Hills | MI 48326  
248.656.1377

PROJECT

Livonia Public Schools  
Franklin High School  
Pool Filtration Project

Livonia,  
Michigan

SHEET

Unit Q  
POOL SYSTEMS  
SCHEMATIC

PROJECT NUMBER

2025-042.2

SHEET NUMBER

AQ2.0








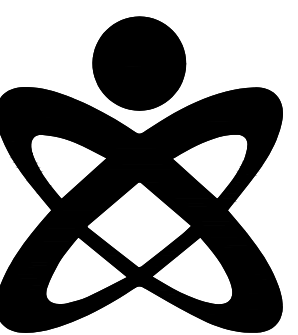




 <b>DEMOLITION KEYED NOTES</b>	
1	POOL CIRCULATION PUMPS REMOVED BY OTHERS. EC TO DISCONNECT AND MAKE SAFE. TAKE CONDUIT AND WIRING BACK TO SWIMMING POOL FILTER PUMP CONTROL PANEL AND PREP CIRCUIT FOR RECONNECTION TO NEW EQUIPMENT. REFER TO NEW WORK PLANS.
2	UV CHAMBER AND CABINET REMOVED BY OTHERS. EC TO DISCONNECT AND MAKE SAFE. PROTECT EXISTING WIRING AND PREP CIRCUIT FOR RECONNECTION TO NEW EQUIPMENT. REFER TO NEW WORK PLANS.



**FRENCH**  
2851 High Meadow Circle | Suite 100  
Auburn Hills | MI 48326  
248.656.1377



UNIFIED BUILDING  
SYSTEMS ENGINEERING  
69 S. GRATIOT AVE.  
MT. CLEMENS, MI 48043  
UBS PROJECT 029.25.12

PROJECT

Livonia Public Schools  
Franklin High School  
Pool Filtration Project

Livonia,  
Michigan

SHEET

ELECTRICAL POWER  
DEMOLITION TUNNEL  
PLAN - UNIT G

PROJECT NUMBER

2025-042.2

SHEET NUMBER

EPD2.00G











NEW WORK KEYED NOTES	
1	NEW CIRC PUMPS PROVIDED BY OTHERS. EC TO CONNECT TO EXISTING CIRCUIT KEPT SAFE DURING DEMOLITION. PROVIDE NEW NEMA 4X 60A 3P 480V DISCONNECT SWITCH MOUNTED ON NEW UNISTRUT SYSTEM. RUN 3#10, 1#10 GND IN 3/4" C
2	NEW UV TREATMENT SYSTEM PROVIDED BY OTHERS. EC TO CONNECT TO EXISTING CIRCUIT KEPT SAFE DURING DEMOLITION. EXTEND WIRING AND CONDUIT AS REQUIRED.
3	ELECTRONIC FLOODLOCATION SYSTEM PROVIDED BY OTHERS. EC TO INSTALL NEW GFCI RECEPTACLE FROM SPARE 120V 20A BREAKER AS SHOWN.
4	ALL CONDUIT AND JUNCTION BOXES SHALL BE PVC.

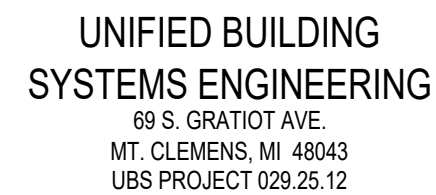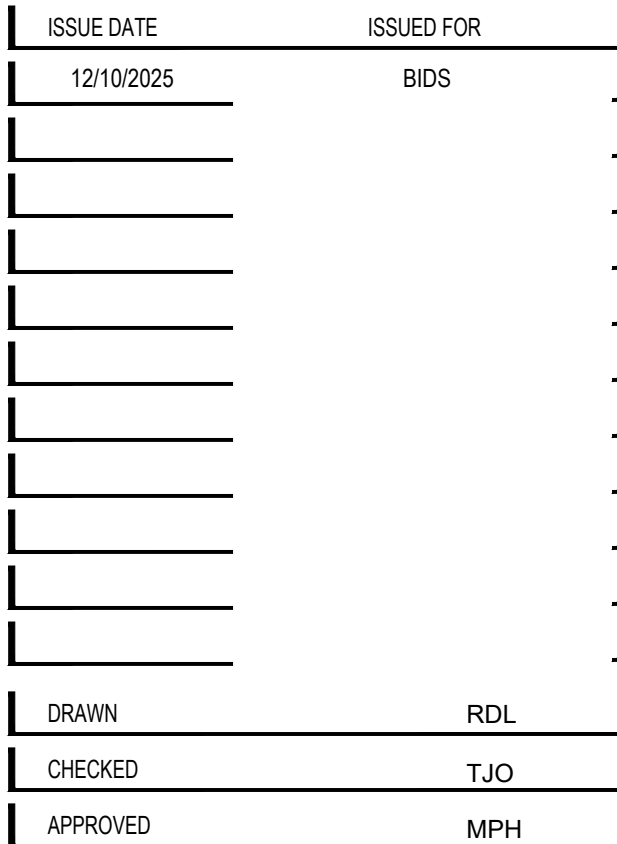

PROJECT

Livonia Public Schools  
Franklin High School  
Pool Filtration Project

Livonia,  
Michigan

SHEET

ELECTRICAL POWER  
NEW WORK TUNNEL  
PLAN - UNIT G

PROJECT NUMBER

2025-042.2



SHEET NUMBER

EP2.00G





<div style="display: flex; align-items: center; justify-content: space-between; padding: 5px;"> <div style="border: 1px solid black; border-radius: 50%; width: 30px; height: 30px; display: flex; align-items: center; justify-content: center;">X</div> <div>NEW WORK KEYED NOTES</div> </div>	
1	CHEMICAL CONTROLLER PROVIDED BY OTHERS. PROVIDE ALL FINAL CONNECTIONS. RECONNECT TO EXISTING CIRCUIT KEPT SAFE DURING DEMOLITION.

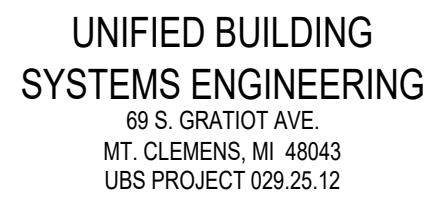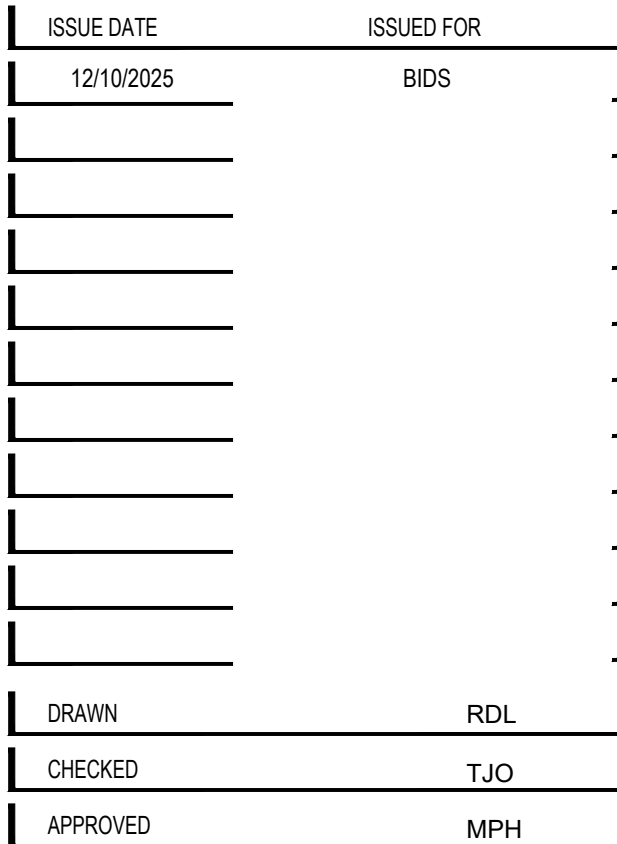

Livonia,  
Michigan

SHEET

ELECTRICAL POWER  
NEW WORK FIRST  
FLOOR PLAN - UNIT G

PROJECT NUMBER


2025-042.2

SHEET NUMBER

EP2.10G



PARTS SPECIFIED IN 680(B)(1) - (B)(7)  
TO BE BONDED TOGETHER USING:  
SOLID COPPER CONDUCTORS, INSULATED COVERED, OR BARE, NOT SMALLER THAN 8 AWG  
RIGID METAL CONDUIT OF BRASS OR OTHER IDENTIFIED CORROSION-RESISTANT METAL

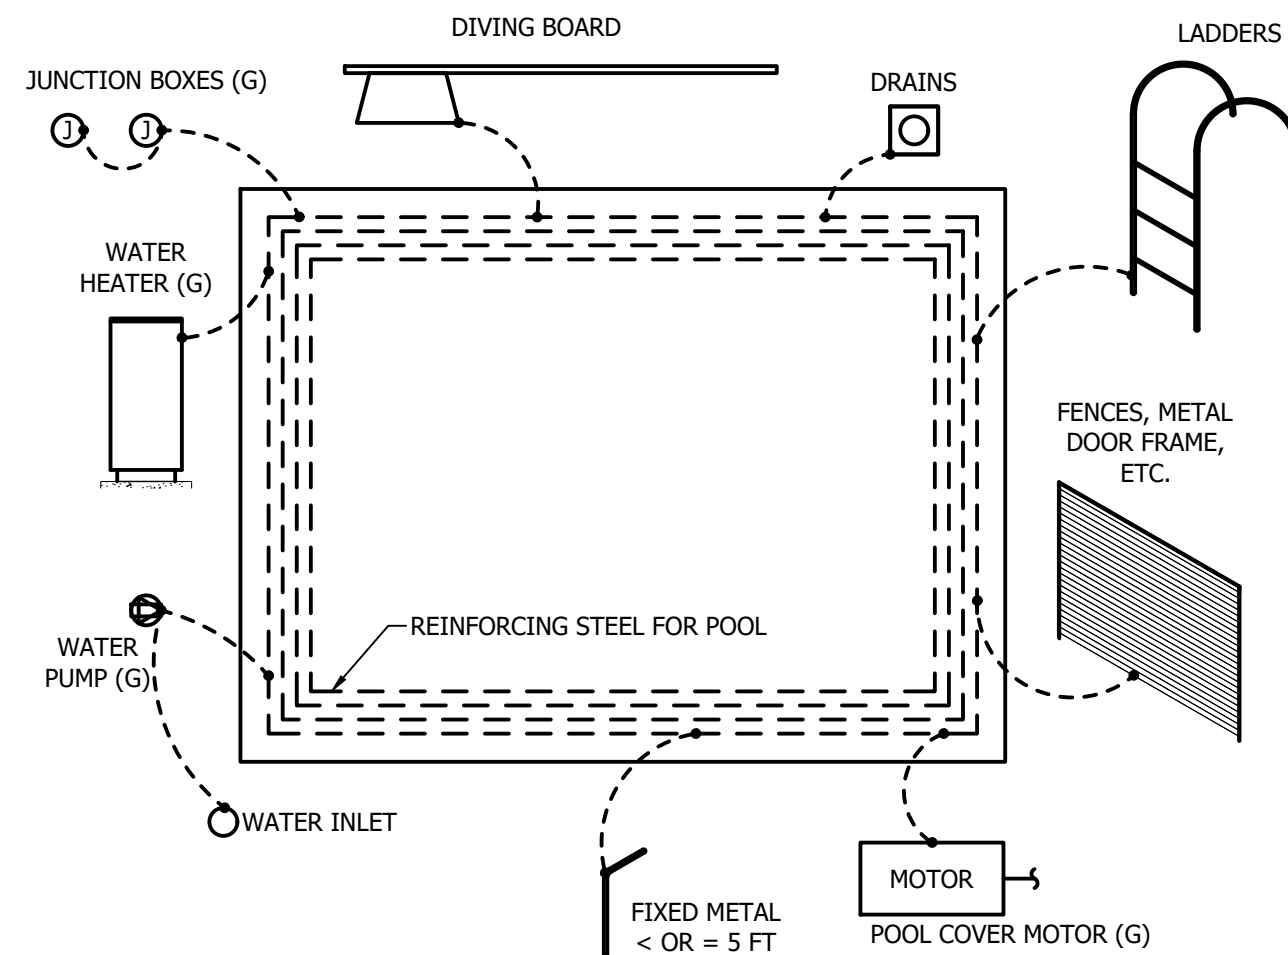

## POOL BONDING DETAIL


NO SCALE

Panel Designation: (E)RP-P					Main: 100A MCB Bussing: 100A					P-P Voltage: 208 P-N Voltage: 120						
Panel Location: POOL TUNNEL					Ground Bus: STANDARD					Phase: 3						
Fed From: EXISTING					Moulnig: S SURFACE					Wire: 4						
Feeder Size: EXISTING					Neutral: 100%					Min SC Interrupting Rating: EXISTING						
Remarks	Light Load	Recept Load	Cont Load	nonC Load	OC Prot	CKT	Ø A	Ø B	Ø C	CKT	OC Prot	nonC Load	Cont Load	Recept Load	Light Load	Remarks
(E)UPPER LEVEL OUTLEITS	540				20	1	X			2	20			540	1000	(E)LOWER LEVEL OUTLEITS
(E)UPPER LEVEL LIGHTS	1000				20	3	X			4	20					(E)LOWER LEVEL LIGHTS
(E)UNIT HEATER WEST			750		20	5	X			6	20	1000				(E)CONDENSATE PUMP
(E)EXISTING LOAD			1000		20	7	X			8	20	555				(E)EXHAUST FAN
(E)ROOF TOP OUTLET	360				20	9	X			10	20		1000			(E)CHEMICAL CONTROLLER
(E)UNIT HEATER EAST			750		20	11	X			12	20			720		(E)CHEMICAL PUMP OUTLET
(E)SPARE					20	13	X			14	20	540				(E)CIRCULATION SYSTEM
(E)SPARE					20	15	X			16	20					(E)SPARE
(E)SPARE					20	17	X			18	20					(E)SPARE
(E)HHWP-19			1000		20	19	X			20	20					(E)SPARE
(E) SPARE					20	21	X			22	20					(E)SPARE
(E) SPARE					20	23	X			24	20					(E)SPARE
(E) SPARE					20	25	X			26	20					(E)SPARE
(E) SPARE					20	27	X			28	20					(E)SPARE
(E) SPARE					20	29	X			30	20					(E)SPARE
(E) SPARE					20	31	X			32	20					(E)SPARE
(E) SPARE					20	33	X			34	20					(E)SPARE
(E) SPARE					20	35	X			36	20					(E)SPARE
(E) SPARE					20	37	X			38	20					(E)SPARE
(E) SPARE					20	39	X			40	20					(E)SPARE
(E) SPARE					20	41	X			42	20					(E)SPARE
	Connected Load					Demand Factor					Demand Load					
Load Description	ØA	ØB	ØC	Total		Factor					ØA	ØB	ØC	Total		
Lighting or Continuous Load (Volt-Amps)	0	2000	0	2000		1.00					0	2000	0	2000		
180VA Receptacle Load (Volt-Amps)	1080	360	720	2160		1.00 (First 10kVA) 0.50 (> 10kVA)					1080	360	720	2160		
	Amount over 10kVA					1.25					2500	1250	1875	5625		
Continuous Load (Volt-Amps)	2000	1000	1500	4500		0.80					1600	800	1200	3600		
Non-Continuous Load (Volt-Amps)	1995	0	1000	2995		1.25					2494	0	1250	3744		
Total Load (kVA)	4.18	3.36	3.22	10.76		125% of Light/Cont and Recept (<10kVA) Load plus other load					4.46	3.61	3.40	11.46		
Total Ampacity (Amps)	34.8	28.0	26.8	29.9		<<<<< per NEC Article 215.2 <<<<<					37.1	30.1	28.3	31.8		
Minimum Feeder Sizing (Amps)	37.0	32.9	28.3	32.8							39.4	35.0	29.8	34.7		

ISSUE DATE	ISSUED FOR
12/10/2025	BIDS
DRAWN	RDL
CHECKED	TJO
APPROVED	MPH



**FRENCH**  
2851 High Meadow Circle | Suite 100  
Auburn Hills | MI 48326  
248.656.1377

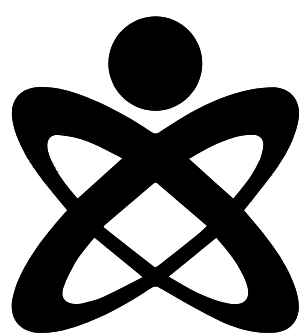

UNIFIED BUILDING  
SYSTEMS ENGINEERING  
69 S. GRATIOT AVE.  
MT. CLEMENS, MI 48043  
UBS PROJECT 029.25.12

PROJECT \_\_\_\_\_

Livonia Public Schools  
Franklin High School  
Pool Filtration Project

Livonia,  
Michigan

SHEET

## ELECTRICAL DETAILS AND PANEL SCHEDULES

PROJECT NUMBER

2025-042.2

SHEET NUMBER

E5.00