

TODD HALL FIRE ALARM PATHWAY AT LIBRARY



Option 1: Painted wiremold inside library with backbox, through wall to device in courtyard.
No conduit/wiremold on exterior of building.



Library has existing wiremold now in some locations

TODD HALL FIRE ALARM PATHWAY AT LIBRARY

Option 2: Painted conduit on outside of building in courtyard to device. No wiremold in library.

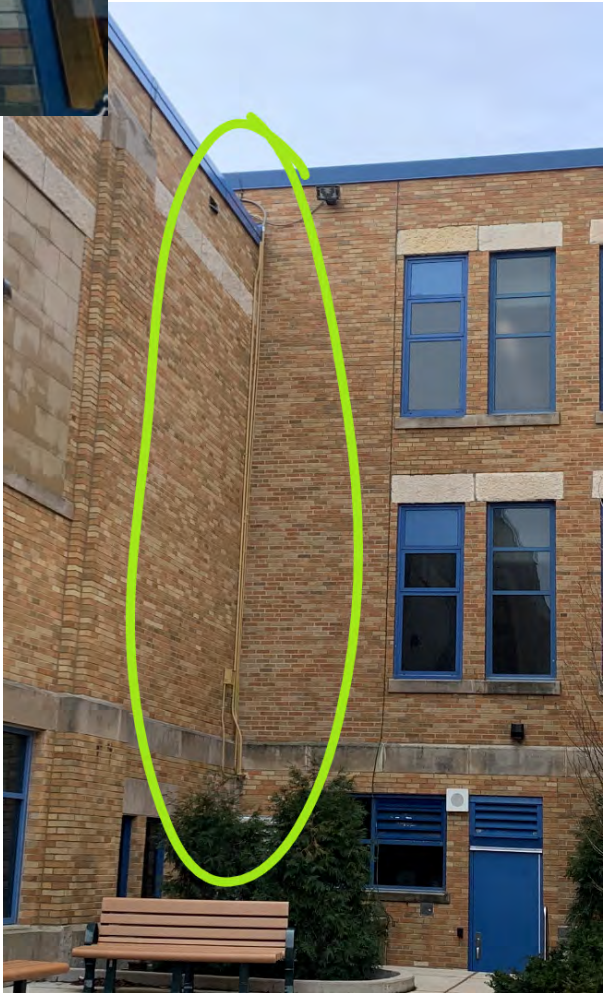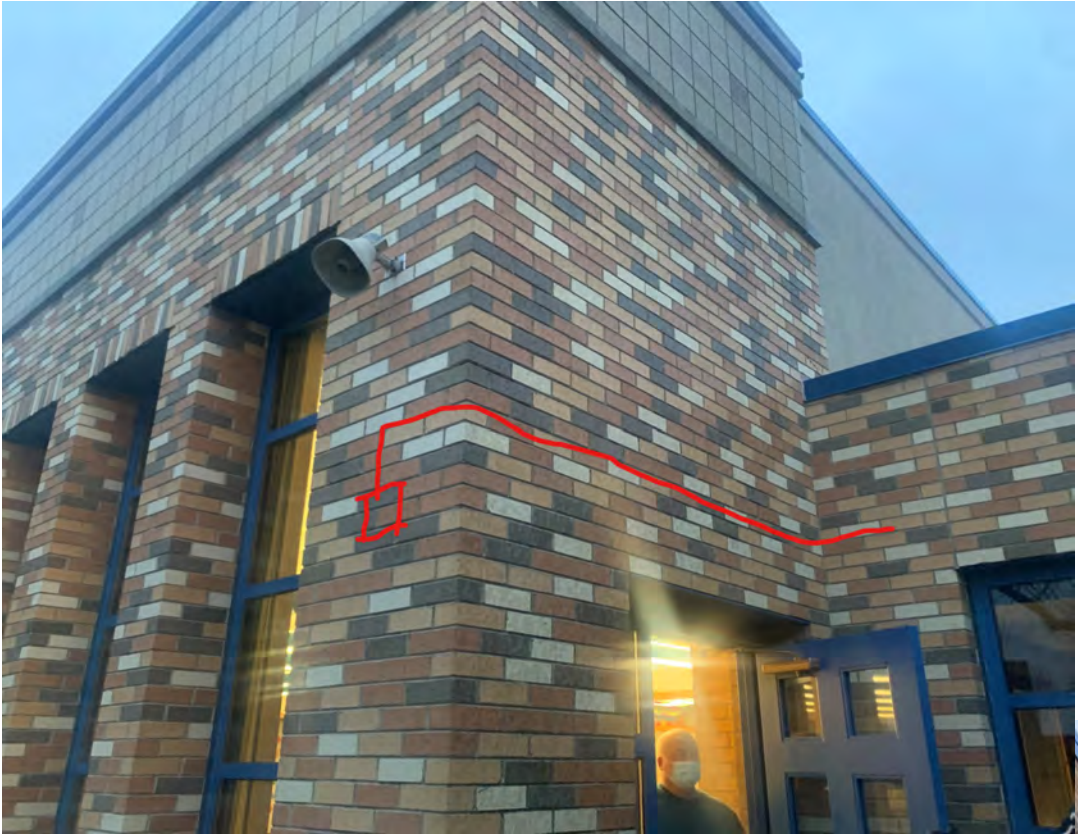

Other locations of painted exterior conduit exist in district (north courtyard at Lincoln Hall)