


Beecher Road School Energy Update

- 2012: Modified (2) Existing Oil Boilers to Dual Fuel Option (Oil & Natural Gas)
- 2014–2016: BRS Building upgrade (substantial completion 2015)
 - A,B, and C wings new exterior walls, doors, and windows.
 - HVAC upgrade installations incl. (3) natural gas boilers
 - Chiller installation for building wide air conditioning
 - Micro turbine installation
 - Security system installations
- 2019: Completion of LEED Lighting Replacements
- 2019-2020: Implemented various recommendations contained in the vanZelm assessment

BEECHER ROAD SCHOOL ENERGY COSTS

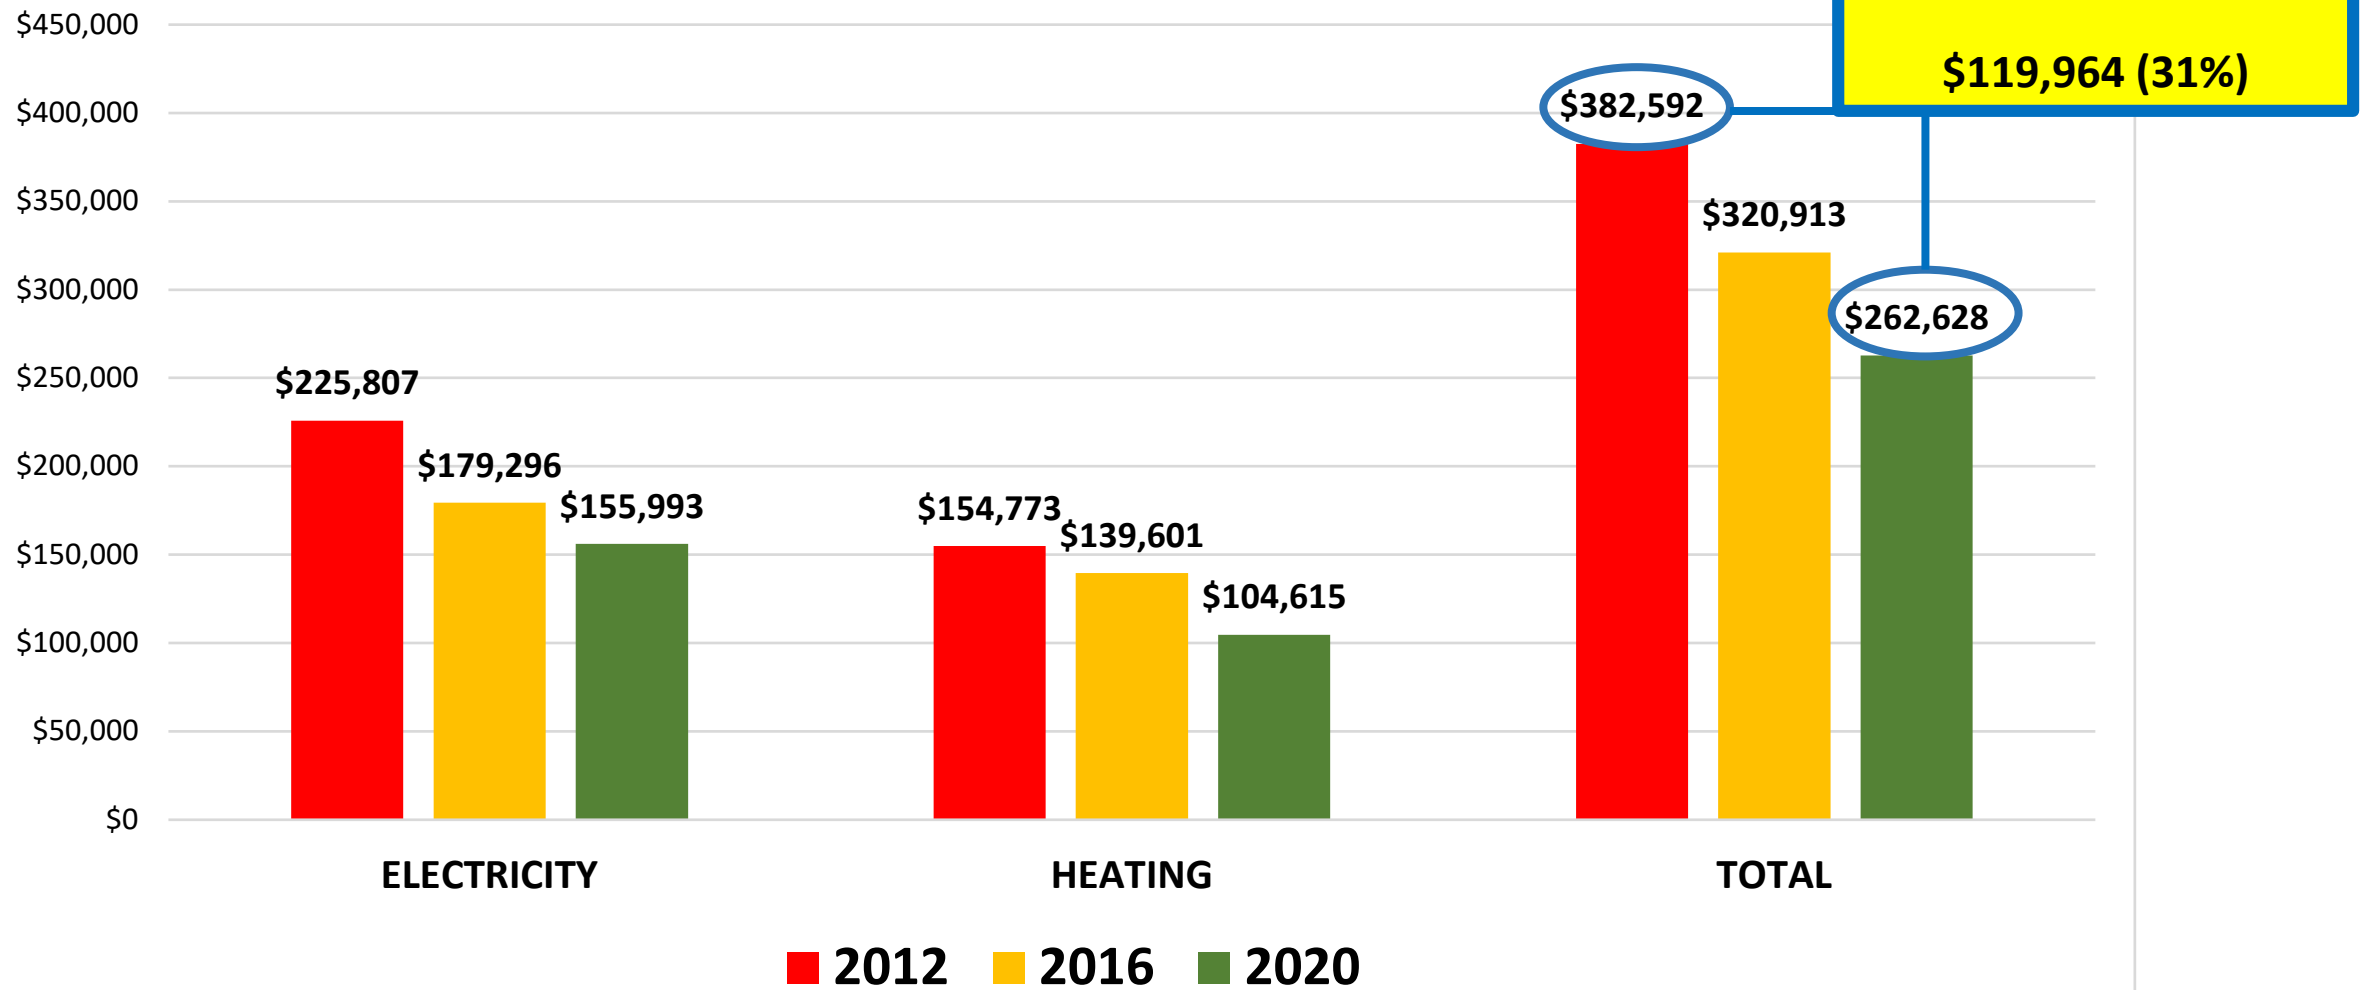

Note: Electricity costs are net of annual Measurement & Verification costs